

IES Indoor Report

Photometric Filename:TR05-10-C5-01 RA90 4000K 36D.IES



Indoor Luminaire Photometric Data

Description Information

Luminary Name: TR05-10-C5-01 RA90 4000K 36D		Lum. Catalog:	Test ID: 01
Lamp Name:		Lamp Catalog: LED	Test Date: 2020/12/18
Manufacture: Shenzhen Norming Lighting Co.Ltd		Shld.Ang(°):	Test Machine:GON-2000
Test Lab: Quality Department	Frequency (Hz):		Lamp CCT(K): Ra:
Lum. Size (W*L*H):0.000m*0.000m*0.000m		Lum. Area (m2):0.000	Lum. W(kg): 0.000
Test System: C, γ	Test Step: C=90.0 γ=1.0	Temp. (°C): 25	Humidity(%): 50.0

Character Parameter

Lamp Speciality Parameter		Luminaire Speciality Parameter	
Rated Flux(lm): 577.880	Luminary Flux(lm): 577.875	Field Angle(10%Imax): 60.8(°)	
Rated Power(W):	Luminary Efficiency: 100.00%	Down Lumens&Percent: 577.507lm 99.94%	
Rated Voltage(V):	Luminary EER(lm/W): 59.630	Up Lumens&Percent: 0.369lm 0.06%	
Tested Power(W): 9.691	Max. Candela(cd): 1402.321	S/MH: C0_a180=0.600 C90_270=0.577	
Lamps' Inside: 1	Max Cand@Ang. (°): C=0.0 γ=2.0	CIE Type: Semi-Direct	
Tested Electrics (V, A, pf):240.1, 0.044, 0.913	Beam Angle(50%Imax): 36.2(°)	ErP φ use(90°): 549.262lm	
Lamp Size (W*L*H):0.000m*0.000m*0.000m	Left=-15.8°, Right=20.4°	IRF(%): 468.958	

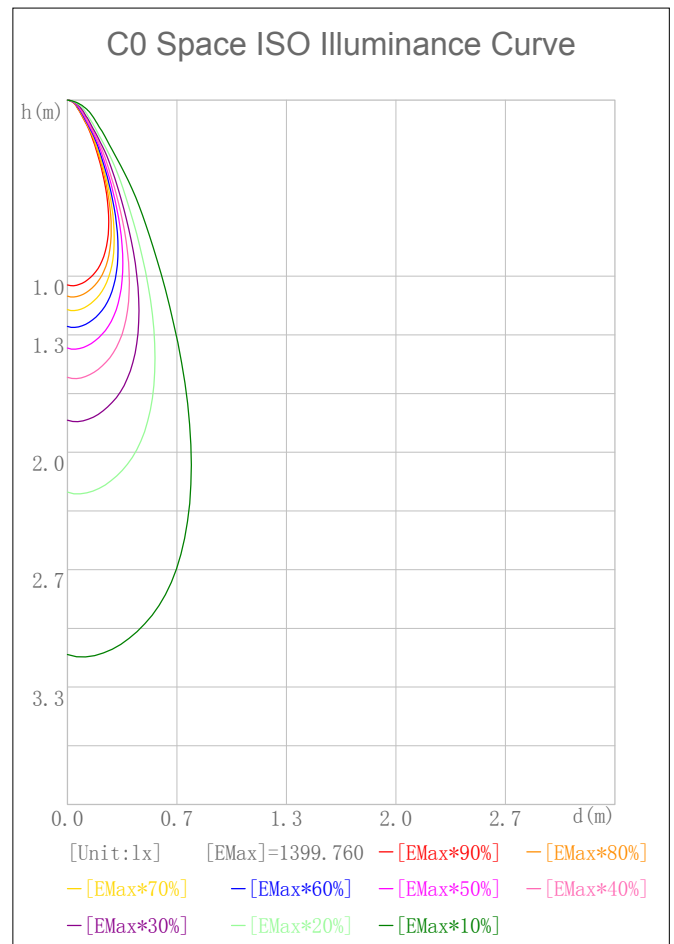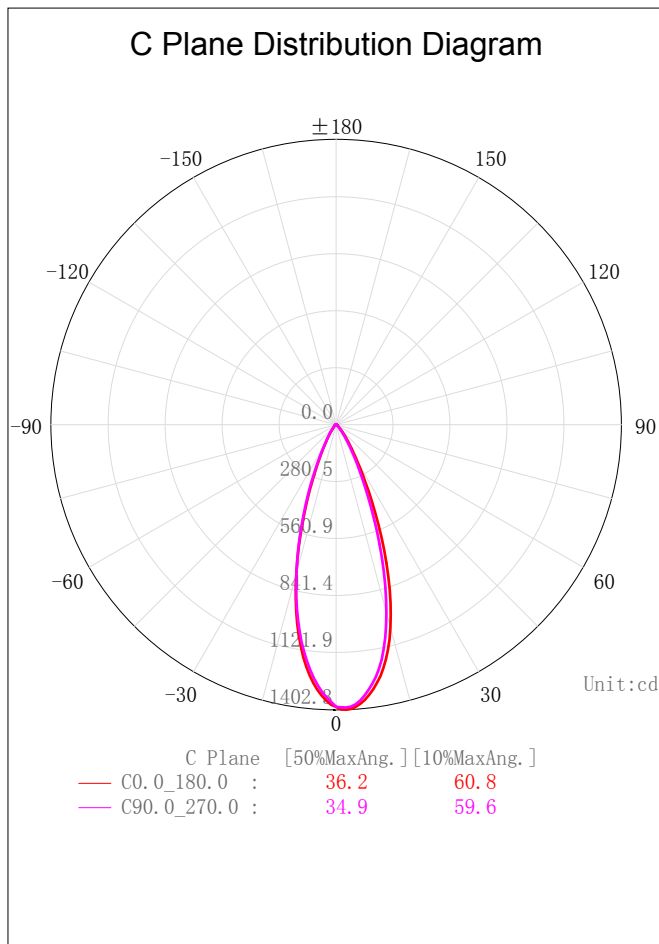



IES Indoor Report

Photometric Filename: TR05-10-C5-01 RA90 4000K 36D.IES

2D Plane Light Intensity Distribution Curve

Lum. Name: TR05-10-C5-01 RA90 4000K 36D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine: GON-2000	Test Date: 2020/12/18

C Plane Distribution Diagram

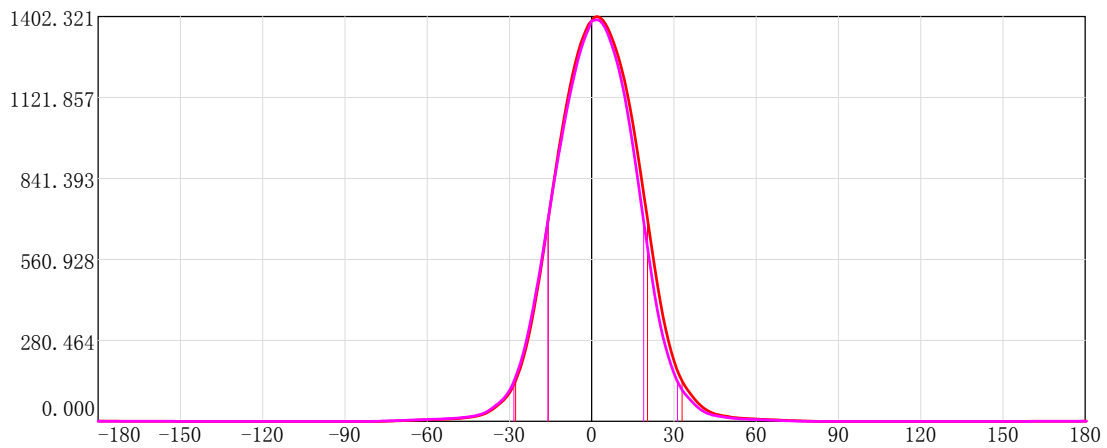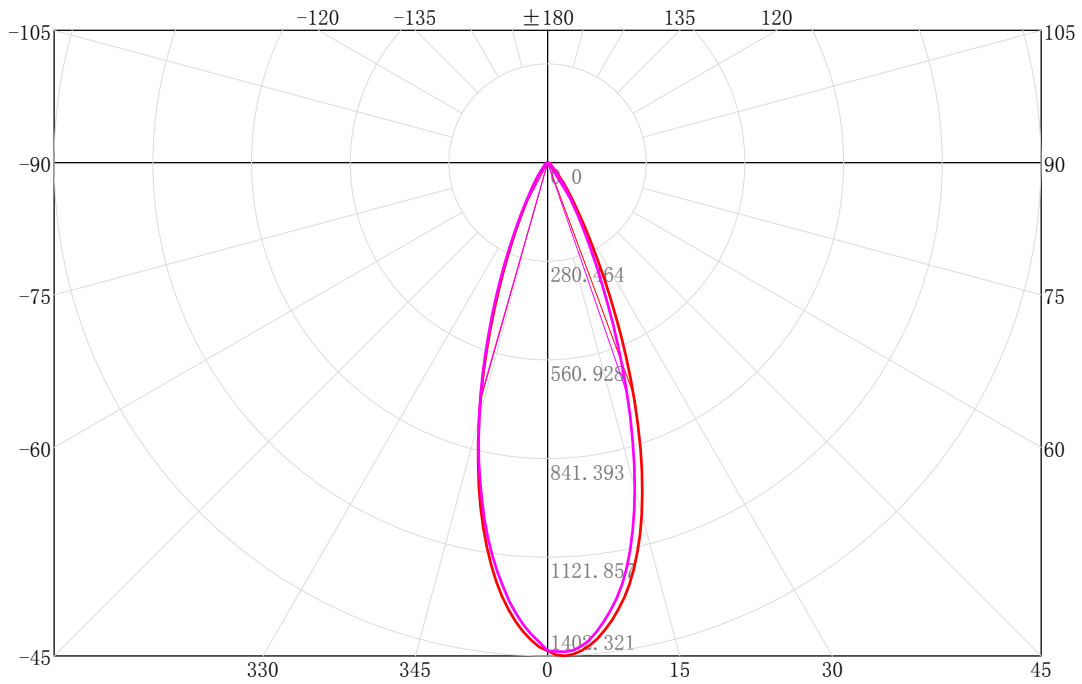

C Plane	[50%MaxAng.]	[10%MaxAng.]
C0.0_180.0	36.2	60.8
C90.0_270.0	34.9	59.6

Unit:cd


IES Indoor Report

Photometric Filename: TR05-10-C5-01 RA90 4000K 36D.IES

3D Light Intensity Distribution Modal

Lum. Name: TR05-10-C5-01 RA90 4000K 36D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine: GON-2000	Test Date: 2020/12/18

3D Light Intensity Distribution Modal

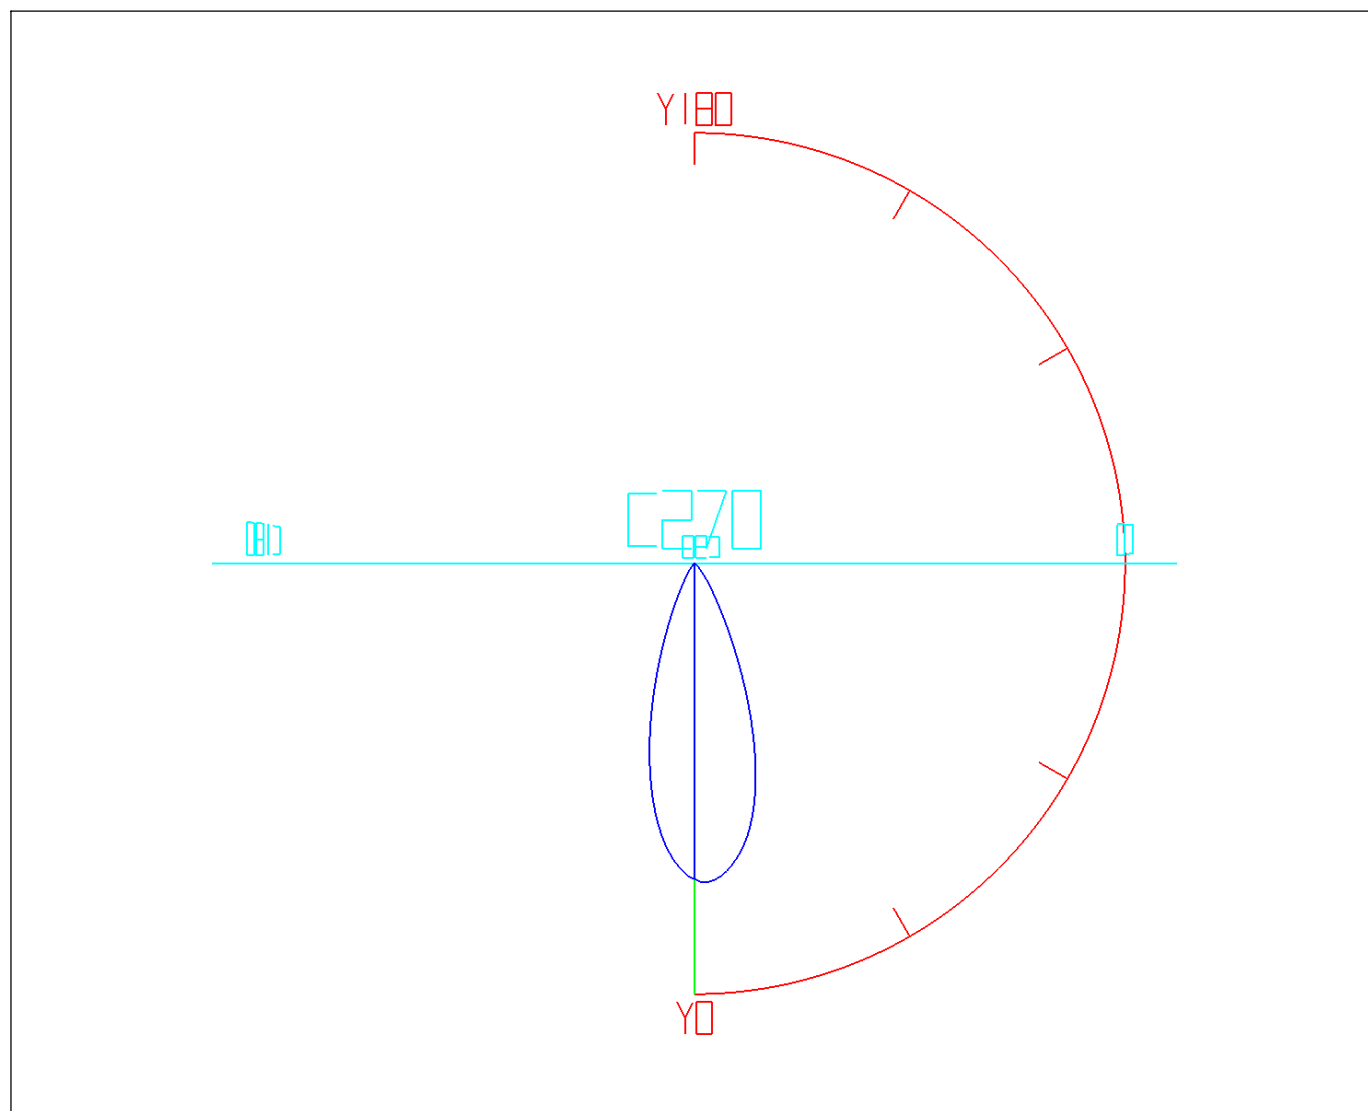

Curves: 3D Model — Fixture — Vert. HUD — Hori. HUD —
View Angles: Orient:0 Tilt:0 Roll:0 Spin:0

IES Indoor Report

Photometric Filename:TR05-10-C5-01 RA90 4000K 36D.IES

Zonal Flux Tabulation

Zone(γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp	Zone(γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp
0.0-1.0	1.33	1.33	0.23	0.23	47.0-48.0	1.24	560.56	0.21	97.00
1.0-2.0	3.95	5.28	0.68	0.91	48.0-49.0	1.15	561.71	0.20	97.20
2.0-3.0	6.53	11.81	1.13	2.04	49.0-50.0	1.08	562.79	0.19	97.39
3.0-4.0	9.03	20.85	1.56	3.61	50.0-51.0	1.00	563.79	0.17	97.56
4.0-5.0	11.43	32.27	1.98	5.58	51.0-52.0	0.94	564.73	0.16	97.72
5.0-6.0	13.68	45.96	2.37	7.95	52.0-53.0	0.89	565.62	0.15	97.88
6.0-7.0	15.78	61.74	2.73	10.68	53.0-54.0	0.85	566.47	0.15	98.03
7.0-8.0	17.71	79.45	3.07	13.75	54.0-55.0	0.81	567.28	0.14	98.17
8.0-9.0	19.46	98.92	3.37	17.12	55.0-56.0	0.78	568.06	0.13	98.30
9.0-10.0	21.00	119.92	3.63	20.75	56.0-57.0	0.75	568.81	0.13	98.43
10.0-11.0	22.30	142.22	3.86	24.61	57.0-58.0	0.72	569.53	0.12	98.55
11.0-12.0	23.34	165.56	4.04	28.65	58.0-59.0	0.69	570.22	0.12	98.67
12.0-13.0	24.11	189.67	4.17	32.82	59.0-60.0	0.66	570.88	0.11	98.79
13.0-14.0	24.60	214.26	4.26	37.08	60.0-61.0	0.63	571.51	0.11	98.90
14.0-15.0	24.80	239.06	4.29	41.37	61.0-62.0	0.60	572.12	0.10	99.00
15.0-16.0	24.71	263.77	4.28	45.64	62.0-63.0	0.58	572.69	0.10	99.10
16.0-17.0	24.33	288.10	4.21	49.86	63.0-64.0	0.55	573.24	0.09	99.20
17.0-18.0	23.69	311.80	4.10	53.96	64.0-65.0	0.51	573.75	0.09	99.29
18.0-19.0	22.81	334.61	3.95	57.90	65.0-66.0	0.48	574.23	0.08	99.37
19.0-20.0	21.74	356.35	3.76	61.67	66.0-67.0	0.45	574.68	0.08	99.45
20.0-21.0	20.50	376.85	3.55	65.21	67.0-68.0	0.41	575.09	0.07	99.52
21.0-22.0	19.13	395.98	3.31	68.52	68.0-69.0	0.37	575.46	0.06	99.58
22.0-23.0	17.67	413.65	3.06	71.58	69.0-70.0	0.34	575.80	0.06	99.64
23.0-24.0	16.18	429.83	2.80	74.38	70.0-71.0	0.30	576.11	0.05	99.69
24.0-25.0	14.71	444.55	2.55	76.93	71.0-72.0	0.27	576.38	0.05	99.74
25.0-26.0	13.30	457.85	2.30	79.23	72.0-73.0	0.24	576.62	0.04	99.78
26.0-27.0	11.95	469.79	2.07	81.30	73.0-74.0	0.21	576.82	0.04	99.82
27.0-28.0	10.68	480.47	1.85	83.14	74.0-75.0	0.18	577.00	0.03	99.85
28.0-29.0	9.52	490.00	1.65	84.79	75.0-76.0	0.15	577.15	0.03	99.87
29.0-30.0	8.48	498.48	1.47	86.26	76.0-77.0	0.12	577.26	0.02	99.89
30.0-31.0	7.57	506.05	1.31	87.57	77.0-78.0	0.09	577.35	0.02	99.91
31.0-32.0	6.77	512.81	1.17	88.74	78.0-79.0	0.06	577.41	0.01	99.92
32.0-33.0	6.09	518.91	1.05	89.79	79.0-80.0	0.04	577.45	0.01	99.93
33.0-34.0	5.50	524.41	0.95	90.75	80.0-81.0	0.03	577.48	0.00	99.93
34.0-35.0	4.96	529.37	0.86	91.61	81.0-82.0	0.02	577.50	0.00	99.93
35.0-36.0	4.45	533.83	0.77	92.38	82.0-83.0	0.01	577.50	0.00	99.93
36.0-37.0	3.97	537.79	0.69	93.06	83.0-84.0	0.00	577.51	0.00	99.94
37.0-38.0	3.50	541.29	0.61	93.67	84.0-85.0	0.00	577.51	0.00	99.94
38.0-39.0	3.07	544.36	0.53	94.20	85.0-86.0	0.00	577.51	0.00	99.94
39.0-40.0	2.68	547.04	0.46	94.66	86.0-87.0	0.00	577.51	0.00	99.94
40.0-41.0	2.36	549.40	0.41	95.07	87.0-88.0	0.00	577.51	0.00	99.94
41.0-42.0	2.09	551.49	0.36	95.43	88.0-89.0	0.00	577.51	0.00	99.94
42.0-43.0	1.86	553.35	0.32	95.76	89.0-90.0	0.00	577.51	0.00	99.94
43.0-44.0	1.68	555.03	0.29	96.05	90.0-91.0	0.00	577.51	0.00	99.94
44.0-45.0	1.54	556.57	0.27	96.31	91.0-92.0	0.00	577.51	0.00	99.94
45.0-46.0	1.42	558.00	0.25	96.56	92.0-93.0	0.00	577.51	0.00	99.94
46.0-47.0	1.32	559.32	0.23	96.79	93.0-94.0	0.00	577.51	0.00	99.94

IES Indoor Report

Photometric Filename:TR05-10-C5-01 RA90 4000K 36D.IES

Zonal Flux Tabulation - (Cont.)

Zone(γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp	Zone(γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp
94.0-95.0	0.00	577.51	0.00	99.94	141.0-142.0	0.00	577.51	0.00	99.94
95.0-96.0	0.00	577.51	0.00	99.94	142.0-143.0	0.00	577.51	0.00	99.94
96.0-97.0	0.00	577.51	0.00	99.94	143.0-144.0	0.00	577.51	0.00	99.94
97.0-98.0	0.00	577.51	0.00	99.94	144.0-145.0	0.00	577.51	0.00	99.94
98.0-99.0	0.00	577.51	0.00	99.94	145.0-146.0	0.00	577.51	0.00	99.94
99.0-100.0	0.00	577.51	0.00	99.94	146.0-147.0	0.00	577.51	0.00	99.94
100.0-101.0	0.00	577.51	0.00	99.94	147.0-148.0	0.00	577.51	0.00	99.94
101.0-102.0	0.00	577.51	0.00	99.94	148.0-149.0	0.00	577.51	0.00	99.94
102.0-103.0	0.00	577.51	0.00	99.94	149.0-150.0	0.00	577.51	0.00	99.94
103.0-104.0	0.00	577.51	0.00	99.94	150.0-151.0	0.00	577.51	0.00	99.94
104.0-105.0	0.00	577.51	0.00	99.94	151.0-152.0	0.01	577.52	0.00	99.94
105.0-106.0	0.00	577.51	0.00	99.94	152.0-153.0	0.01	577.53	0.00	99.94
106.0-107.0	0.00	577.51	0.00	99.94	153.0-154.0	0.01	577.54	0.00	99.94
107.0-108.0	0.00	577.51	0.00	99.94	154.0-155.0	0.01	577.55	0.00	99.94
108.0-109.0	0.00	577.51	0.00	99.94	155.0-156.0	0.01	577.56	0.00	99.94
109.0-110.0	0.00	577.51	0.00	99.94	156.0-157.0	0.01	577.57	0.00	99.95
110.0-111.0	0.00	577.51	0.00	99.94	157.0-158.0	0.02	577.59	0.00	99.95
111.0-112.0	0.00	577.51	0.00	99.94	158.0-159.0	0.02	577.61	0.00	99.95
112.0-113.0	0.00	577.51	0.00	99.94	159.0-160.0	0.02	577.63	0.00	99.96
113.0-114.0	0.00	577.51	0.00	99.94	160.0-161.0	0.02	577.65	0.00	99.96
114.0-115.0	0.00	577.51	0.00	99.94	161.0-162.0	0.02	577.67	0.00	99.96
115.0-116.0	0.00	577.51	0.00	99.94	162.0-163.0	0.02	577.69	0.00	99.97
116.0-117.0	0.00	577.51	0.00	99.94	163.0-164.0	0.02	577.70	0.00	99.97
117.0-118.0	0.00	577.51	0.00	99.94	164.0-165.0	0.02	577.72	0.00	99.97
118.0-119.0	0.00	577.51	0.00	99.94	165.0-166.0	0.02	577.74	0.00	99.98
119.0-120.0	0.00	577.51	0.00	99.94	166.0-167.0	0.02	577.76	0.00	99.98
120.0-121.0	0.00	577.51	0.00	99.94	167.0-168.0	0.02	577.77	0.00	99.98
121.0-122.0	0.00	577.51	0.00	99.94	168.0-169.0	0.02	577.79	0.00	99.98
122.0-123.0	0.00	577.51	0.00	99.94	169.0-170.0	0.01	577.80	0.00	99.99
123.0-124.0	0.00	577.51	0.00	99.94	170.0-171.0	0.01	577.82	0.00	99.99
124.0-125.0	0.00	577.51	0.00	99.94	171.0-172.0	0.01	577.83	0.00	99.99
125.0-126.0	0.00	577.51	0.00	99.94	172.0-173.0	0.01	577.84	0.00	99.99
126.0-127.0	0.00	577.51	0.00	99.94	173.0-174.0	0.01	577.85	0.00	99.99
127.0-128.0	0.00	577.51	0.00	99.94	174.0-175.0	0.01	577.86	0.00	100.00
128.0-129.0	0.00	577.51	0.00	99.94	175.0-176.0	0.01	577.86	0.00	100.00
129.0-130.0	0.00	577.51	0.00	99.94	176.0-177.0	0.01	577.87	0.00	100.00
130.0-131.0	0.00	577.51	0.00	99.94	177.0-178.0	0.00	577.87	0.00	100.00
131.0-132.0	0.00	577.51	0.00	99.94	178.0-179.0	0.00	577.87	0.00	100.00
132.0-133.0	0.00	577.51	0.00	99.94	179.0-180.0	0.00	577.88	0.00	100.00
133.0-134.0	0.00	577.51	0.00	99.94					
134.0-135.0	0.00	577.51	0.00	99.94					
135.0-136.0	0.00	577.51	0.00	99.94					
136.0-137.0	0.00	577.51	0.00	99.94					
137.0-138.0	0.00	577.51	0.00	99.94					
138.0-139.0	0.00	577.51	0.00	99.94					
139.0-140.0	0.00	577.51	0.00	99.94					
140.0-141.0	0.00	577.51	0.00	99.94					


IES Indoor Report

Photometric Filename:TR05-10-C5-01 RA90 4000K 36D.IES

Rectangle ISO Lighting Intensity Diagram

Lum. Name: TR05-10-C5-01 RA90 4000K 36D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/18

ISO Lighting Intensity Curve

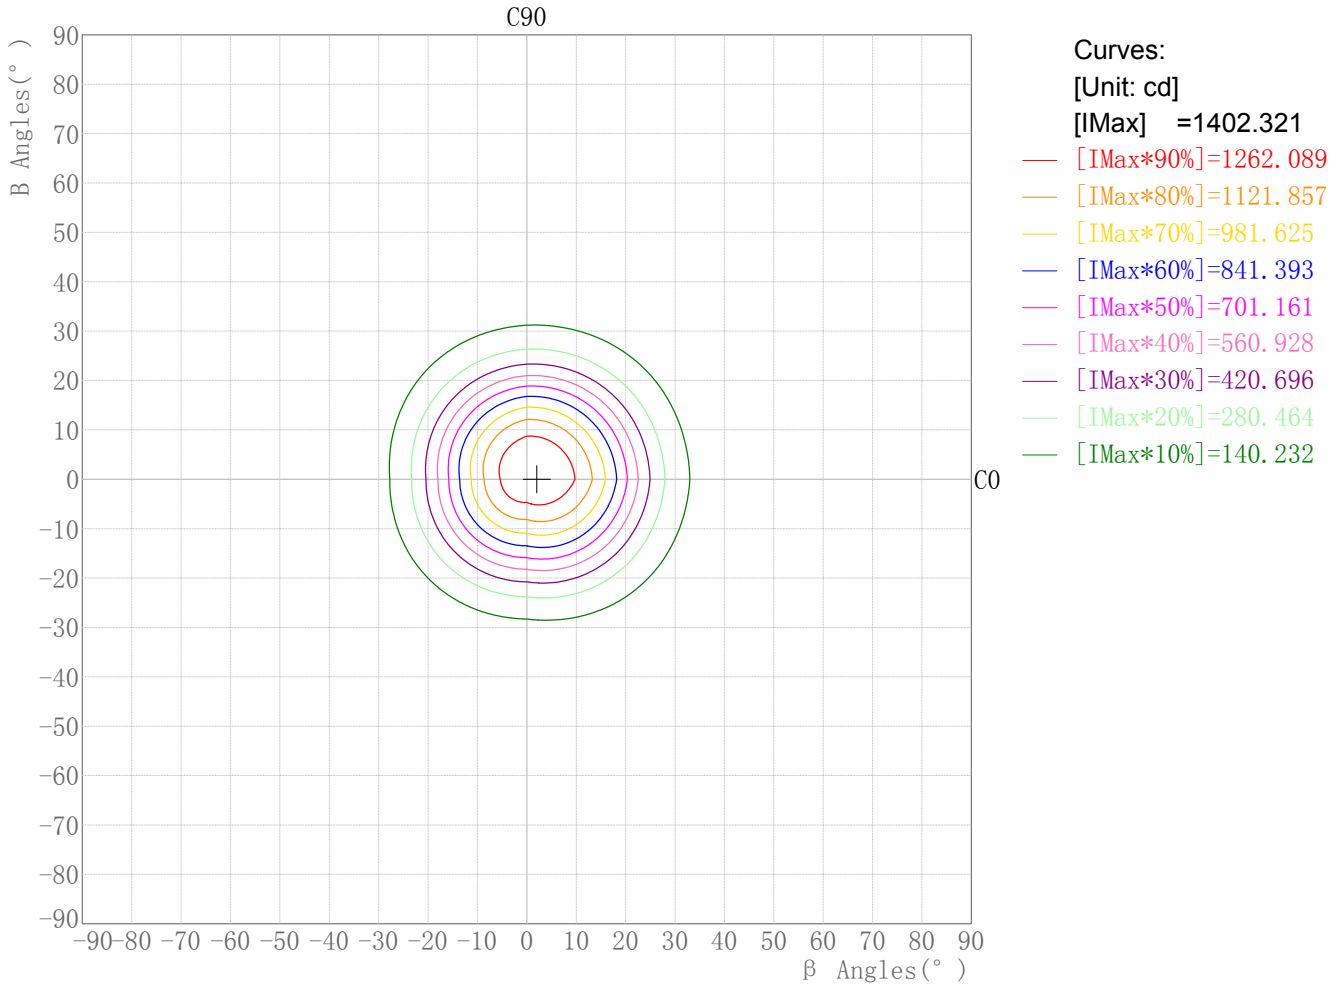

Maximum Light Intensity(cd): 1402.32

Maximum Cand.@Angle: H=2.0°,V=0.0°


IES Indoor Report

Photometric Filename:TR05-10-C5-01 RA90 4000K 36D.IES

Plane ISO-Illuminance Diagram

Lum. Name: TR05-10-C5-01 RA90 4000K 36D	Lum. Catalog: LED	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/18

Plane ISO-Illuminance Curve

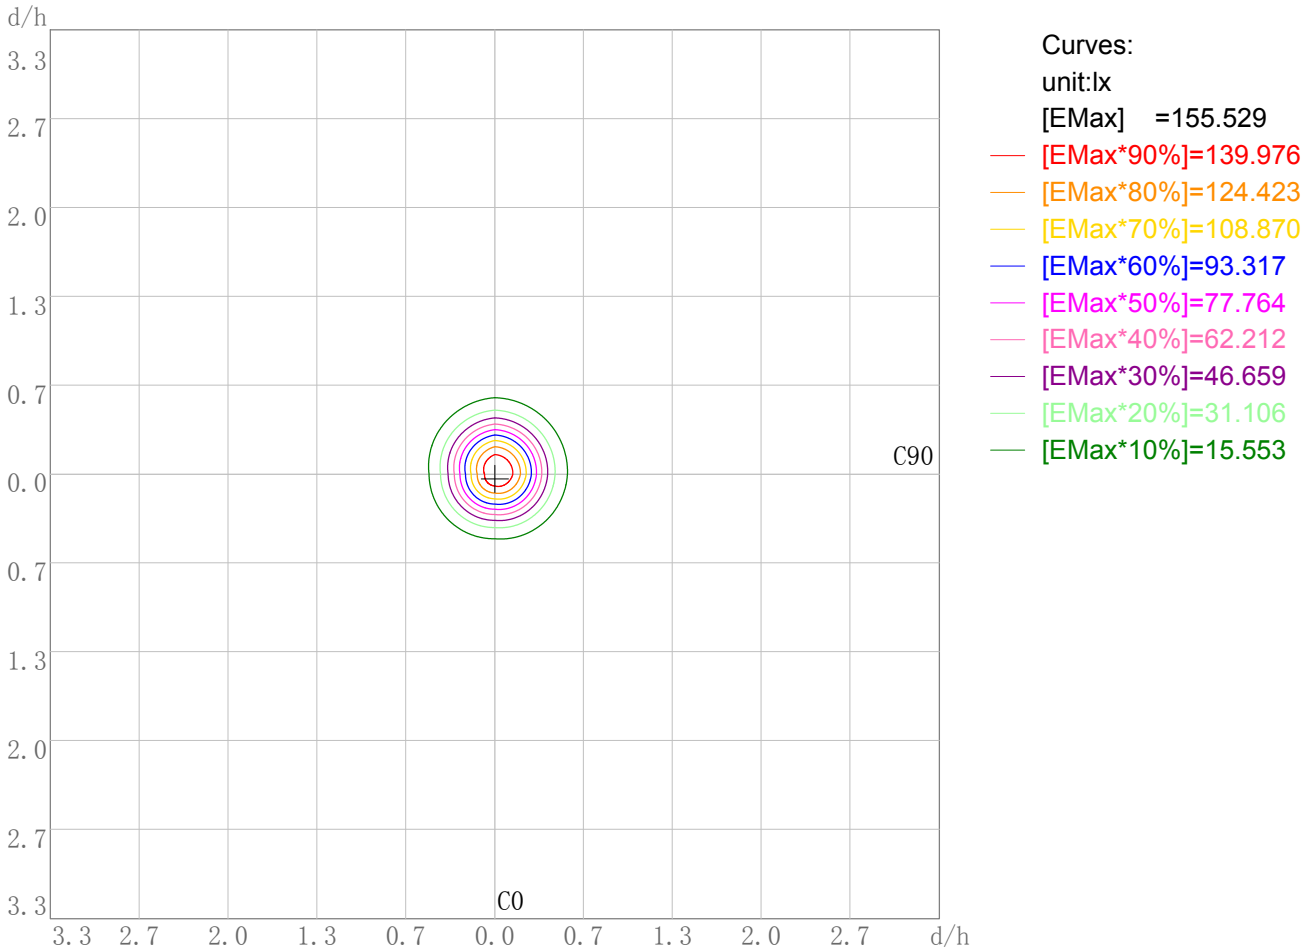


IES Indoor Report

Photometric Filename:TR05-10-C5-01 RA90 4000K 36D.IES

3D Plane ISO Illuminance Diagram

Lum. Name: TR05-10-C5-01 RA90 4000K 36D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/18

3D Plane Illuminance Modal

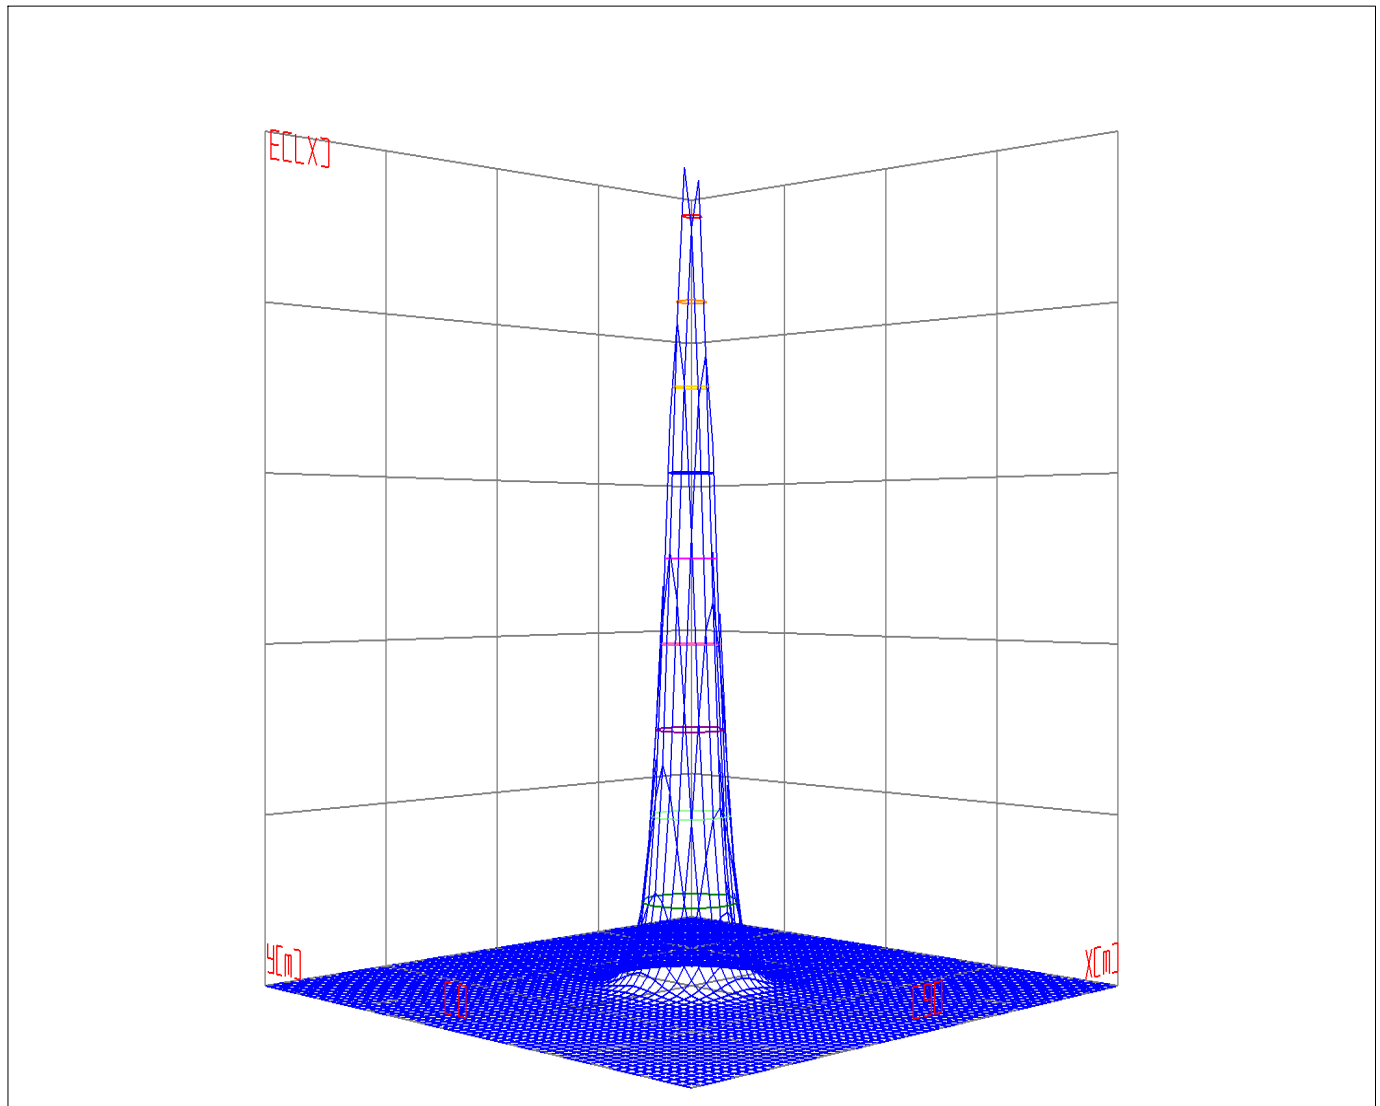

Curves: 3D Model — 90% — 80% — 70% — 60% — 50% — 40% — 30% — 20% — 10% —
View Angles(deg): 0 Height(m): 3.0 Distance(m): 10.0


IES Indoor Report

Photometric Filename:TR05-10-C5-01 RA90 4000K 36D.IES

Space ISO Illuminance Diagram

Lum. Name: TR05-10-C5-01 RA90 4000K 36D	Lum. Catalog: LED	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/18

Space ISO Illuminance Curve

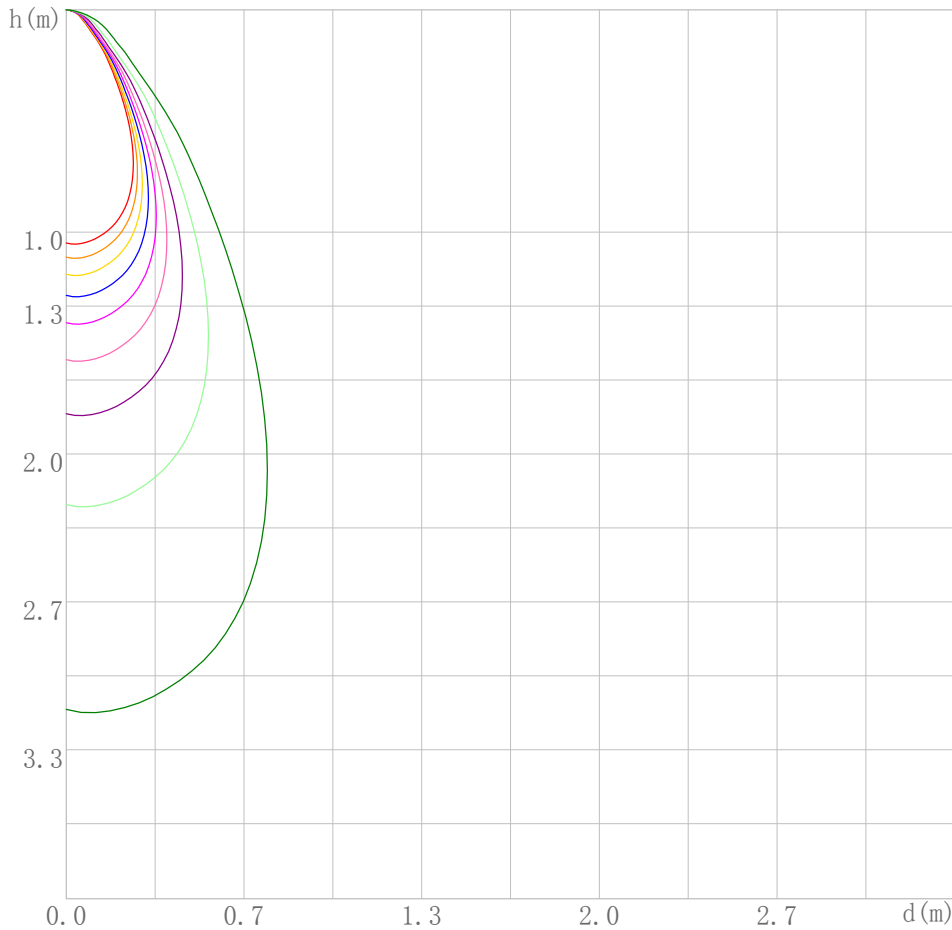

- Curves:
[Unit: lx]
[EMax] =1399.760
- [EMax*90%]=1259.784
 - [EMax*80%]=1119.808
 - [EMax*70%]=979.832
 - [EMax*60%]=839.856
 - [EMax*50%]=699.880
 - [EMax*40%]=559.904
 - [EMax*30%]=419.928
 - [EMax*20%]=279.952
 - [EMax*10%]=139.976

Space Plane Maximum Illuminance and @Angle:1399.76lx,2.0deg
Plane Maximum Lighting Intensity and @Angle:1402.321cd,0deg


IES Indoor Report

Photometric Filename: TR05-10-C5-01 RA90 4000K 36D.IES

Illuminance-Distance Diagram

Lum. Name: TR05-10-C5-01 RA90 4000K 36D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine: GON-2000	Test Date: 2020/12/18

Illuminance-Distance Curve

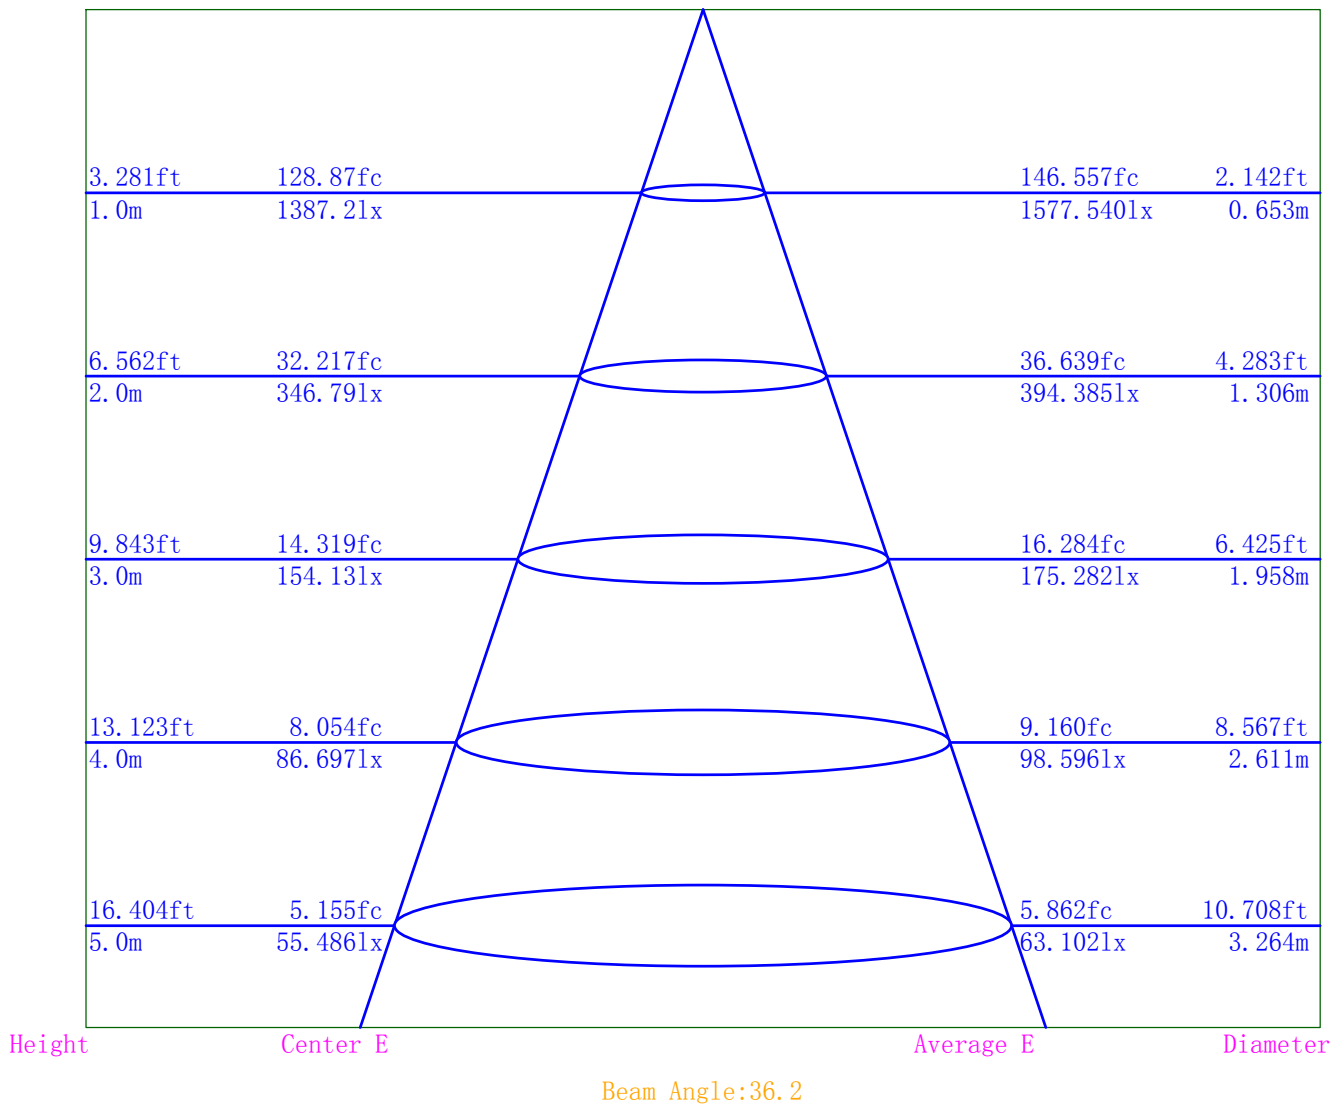

Indoor Luminance Limiting Curves

Lum. Name: TR05-10-C5-01 RA90 4000K 36D	Lum. Catalog: LED	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/18


Glare Grade Table

GI	Quality	Using Illuminance							
		a	b	c	d	e	f	g	h
1.15	A	2000	1000	500	<=300				
1.5	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.2	D				2000	1000	500	<=300	
2.55	E	a				2000	1000	500	<=300
			b	c	d	e	f	g	h

Luminance Table

Gama (deg)	45	50	55	60	65	70	75	80	85
C0	0	0	0	0	0	0	0	0	0
C90	0	0	0	0	0	0	0	0	0

Luminance Limiting Curve

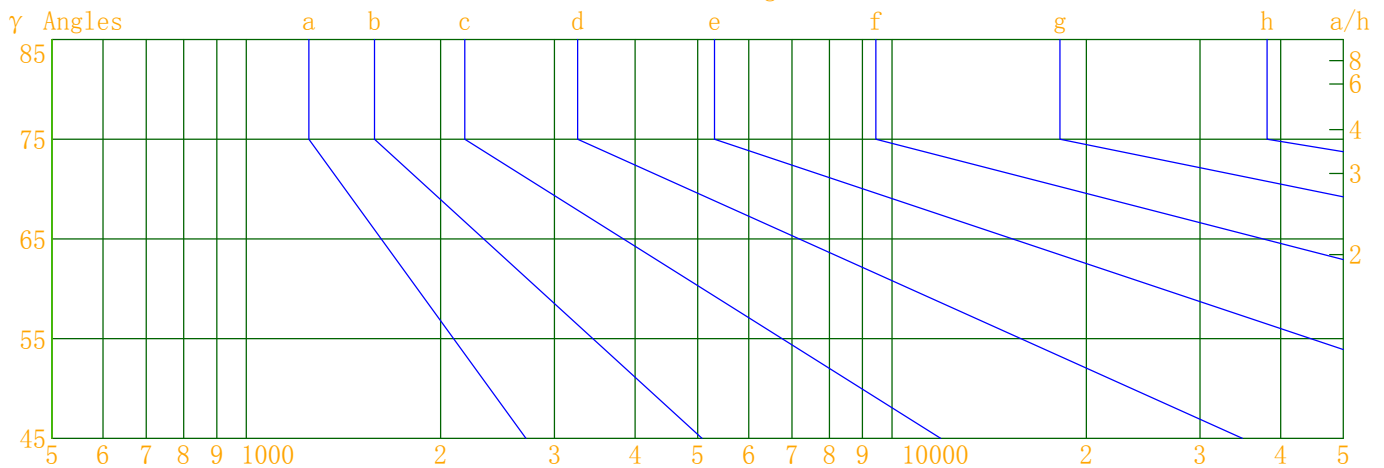


Luminous Size: Length(m)=0.000 Width(m)=0.000 Height(m)=0.000 Area(m²)=0.000000
 Luminous Type: Without Luminous Side
 Luminous Curves: C0-C180 Color: — C90-C270 Color: —

IES Indoor Report

Photometric Filename: TR05-10-C5-01 RA90 4000K 36D.IES

Indoor Budgetary Estimate Table

Lum. Name: TR05-10-C5-01 RA90 4000K 36D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine: GON-2000	Test Date: 2020/12/18

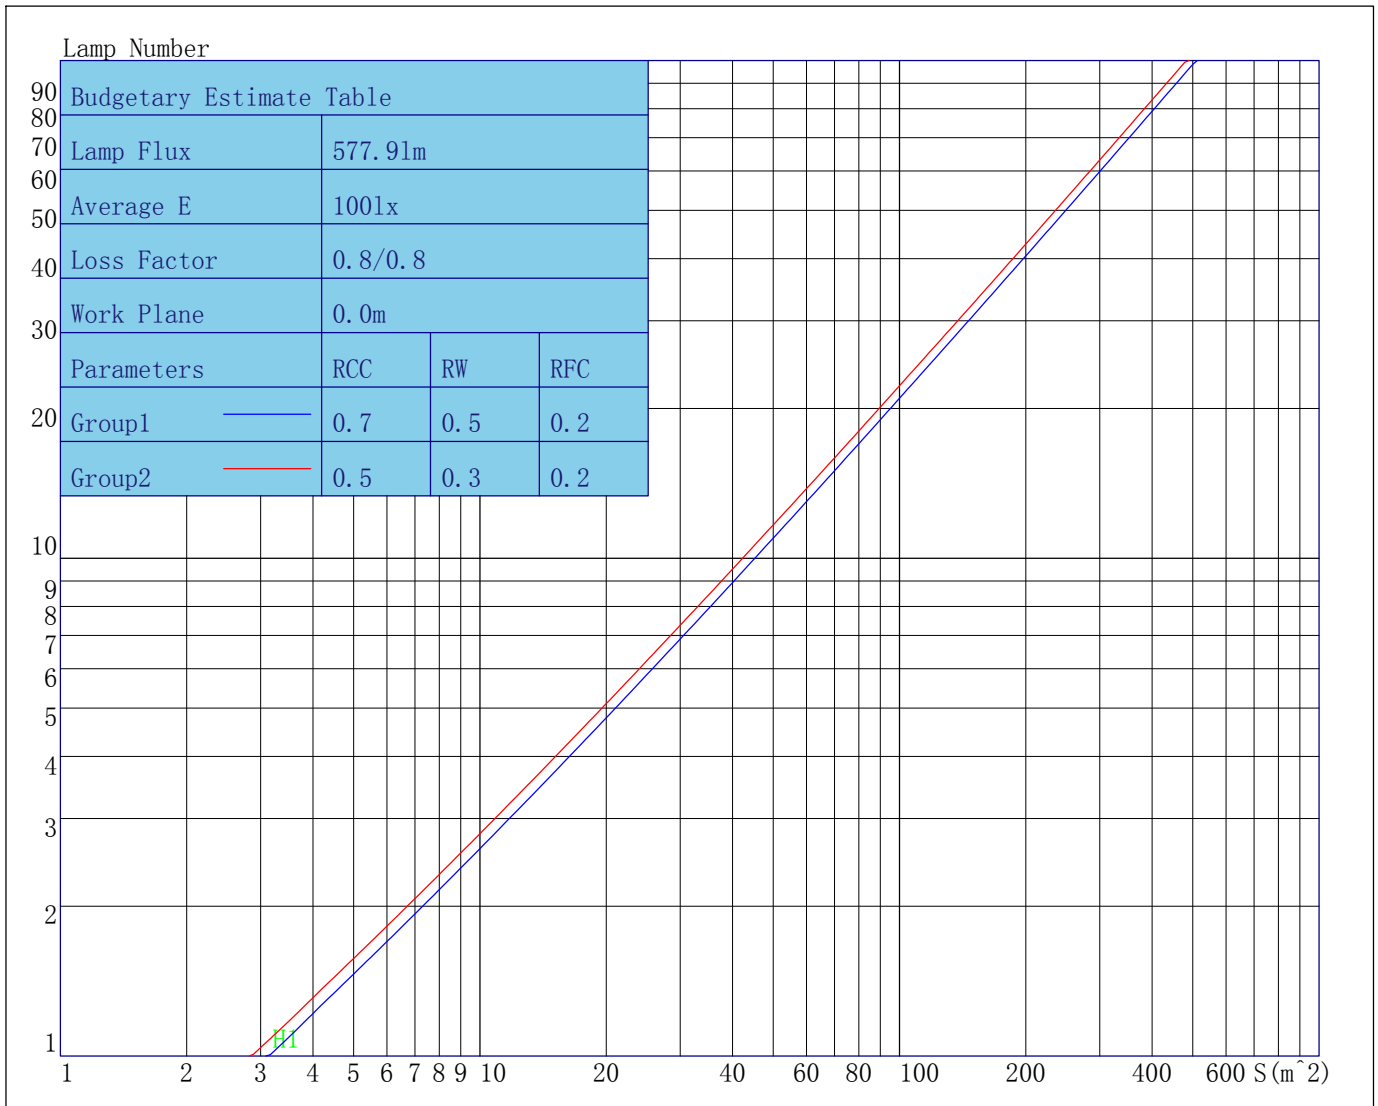

Parameters1: Rhocc = 0.7 Rhow = 0.5 Rhofc = 0.2 LLF = 0.8
 Parameters2: Rhocc = 0.5 Rhow = 0.3 Rhofc = 0.2 LLF = 0.8
 Average Illuminance(lx): 100 Cavity Height: H1(m) = 2

IES Indoor Report

Photometric Filename:TR05-10-C5-01 RA90 4000K 36D.IES

Indoor Coefficient of Utilization Table

Lum. Name: TR05-10-C5-01 RA90 4000K 36D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/18

Coefficients of Utilization - Zonal Cavity Method																		
Coef.	Effective Floor Cavity Reflectance RFC=0.20																	
RhoCC (%)	80				70				50			30			10			0
RhoW (%)	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR	Coefficient of Utilization (%)																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	112	109	107	112	110	108	106	106	104	103	102	101	99	98	97	97	95
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90
3	105	99	95	92	103	98	94	91	95	92	89	93	90	88	91	89	87	85
4	101	94	89	86	99	93	89	85	91	87	84	89	86	83	87	85	82	81
5	97	90	85	81	95	89	84	81	87	83	80	85	82	79	84	81	79	77
6	93	85	80	77	92	85	80	76	83	79	76	82	78	75	81	78	75	74
7	89	82	77	73	88	81	76	73	80	76	72	79	75	72	78	74	72	71
8	86	78	73	70	85	78	73	70	77	72	69	76	72	69	75	71	69	68
9	83	75	70	67	82	75	70	67	74	69	66	73	69	66	72	69	66	65
10	80	72	67	64	79	72	67	64	71	67	64	70	66	64	70	66	63	62

IES Indoor Report

Photometric Filename:TR05-10-C5-01 RA90 4000K 36D.IES

Unified Glare Rating Table

Lum. Name: TR05-10-C5-01 RA90 4000K 36D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/18

Unified Glare Rating Table

Ceiling RCC	0.70	0.70	0.50	0.50	0.30	0.70	0.70	0.50	0.50	0.30
Wall RW	0.50	0.30	0.50	0.30	0.30	0.50	0.30	0.50	0.30	0.30
Floor RFC	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20
Room Size	Viewed crosswise					Viewed endwise				
X=2H Y=2H	-2.8	-1.8	-2.4	-1.5	-1.2	-2.8	-1.8	-2.4	-1.5	-1.2
Y=3H	-3.0	-2.1	-2.6	-1.8	-1.4	-3.0	-2.1	-2.6	-1.8	-1.4
Y=4H	-3.1	-2.3	-2.7	-1.9	-1.5	-3.1	-2.3	-2.7	-1.9	-1.5
Y=6H	-3.2	-2.5	-2.8	-2.1	-1.7	-3.2	-2.5	-2.8	-2.1	-1.7
Y=8H	-3.3	-2.6	-2.8	-2.2	-1.8	-3.3	-2.6	-2.8	-2.2	-1.8
Y=12H	-3.3	-2.7	-2.9	-2.3	-1.8	-3.3	-2.7	-2.9	-2.3	-1.8
X=4H Y=2H	-3.1	-2.3	-2.7	-1.9	-1.5	-3.1	-2.3	-2.7	-1.9	-1.5
Y=3H	-3.3	-2.6	-2.9	-2.2	-1.8	-3.3	-2.6	-2.9	-2.2	-1.8
Y=4H	-3.4	-2.8	-3.0	-2.4	-2.0	-3.4	-2.8	-3.0	-2.4	-2.0
Y=6H	-3.5	-3.0	-3.1	-2.6	-2.1	-3.5	-3.0	-3.1	-2.6	-2.1
Y=8H	-3.6	-3.1	-3.1	-2.7	-2.2	-3.6	-3.1	-3.1	-2.7	-2.2
Y=12H	-3.7	-3.3	-3.2	-2.8	-2.3	-3.7	-3.3	-3.2	-2.8	-2.3
X=8H Y=4H	-3.6	-3.1	-3.1	-2.7	-2.2	-3.6	-3.1	-3.1	-2.7	-2.2
Y=6H	-3.7	-3.4	-3.2	-2.9	-2.3	-3.7	-3.4	-3.2	-2.9	-2.3
Y=8H	-3.8	-3.5	-3.3	-3.0	-2.5	-3.8	-3.5	-3.3	-3.0	-2.5
Y=12H	-3.9	-3.6	-3.4	-3.1	-2.5	-3.9	-3.6	-3.4	-3.1	-2.5
X=12H Y=4H	-3.7	-3.3	-3.2	-2.8	-2.3	-3.7	-3.3	-3.2	-2.8	-2.3
Y=6H	-3.8	-3.5	-3.3	-3.0	-2.5	-3.8	-3.5	-3.3	-3.0	-2.5
Y=8H	-3.9	-3.6	-3.4	-3.1	-2.5	-3.9	-3.6	-3.4	-3.1	-2.5
Variations with the observer position at spacings										
S=1.0H	0.0/0.0					0.0/0.0				
S=1.5H	0.0/0.0					0.0/0.0				
S=2.0H	0.0/0.0					0.0/0.0				
Reduced UGR Table:										
Nordic Standard Table:	BKO					BKO				
Correction Value	0.0					0.0				

to the CIE Pub.117, data has been corrected, refers to the lamp's lumens 8.2flm.

IES Indoor Report

Photometric Filename: TR05-10-C5-01 RA90 4000K 36D.IES

Candela Tabulation

V/H	C0.0	C90.0	C180.0	C270.0
γ 0.0	1387.15	1387.15	1387.15	1387.15
γ 1.0	1399.58	1389.56	1376.74	1362.53
γ 2.0	1402.32	1390.98	1357.15	1340.79
γ 3.0	1398.91	1388.03	1334.21	1315.28
γ 4.0	1389.85	1377.40	1307.34	1284.93
γ 5.0	1376.82	1361.59	1275.28	1251.23
γ 6.0	1359.68	1339.26	1239.42	1211.66
γ 7.0	1337.50	1312.81	1199.34	1171.44
γ 8.0	1313.03	1284.67	1154.05	1128.01
γ 9.0	1285.09	1253.63	1105.24	1081.63
γ 10.0	1254.70	1217.15	1054.02	1031.57
γ 11.0	1219.36	1175.07	998.03	978.21
γ 12.0	1179.35	1127.20	939.86	923.79
γ 13.0	1134.60	1073.84	878.25	868.48
γ 14.0	1086.53	1016.88	816.48	811.05
γ 15.0	1032.90	956.40	753.02	752.55
γ 16.0	975.79	892.36	688.39	693.21
γ 17.0	915.87	826.77	624.50	633.23
γ 18.0	853.53	759.18	561.25	574.08
γ 19.0	788.59	692.12	500.43	516.08
γ 20.0	723.84	624.96	443.36	461.51
γ 21.0	659.11	560.25	388.68	408.79
γ 22.0	595.03	497.36	338.47	359.53
γ 23.0	533.13	437.59	293.36	314.25
γ 24.0	473.54	384.08	252.57	272.07
γ 25.0	417.69	336.37	217.50	234.73
γ 26.0	366.02	294.03	185.72	201.48
γ 27.0	318.75	256.34	158.42	172.30
γ 28.0	278.18	222.98	134.15	146.84
γ 29.0	242.02	193.45	114.11	124.36
γ 30.0	210.65	167.25	98.20	106.57
γ 31.0	182.59	144.13	85.60	92.42
γ 32.0	159.81	125.04	74.90	80.55
γ 33.0	140.25	109.38	65.92	71.37
γ 34.0	123.37	96.18	58.01	62.91
γ 35.0	108.66	84.61	49.90	55.38
γ 36.0	95.69	74.35	42.95	47.97
γ 37.0	83.88	64.51	36.43	41.08
γ 38.0	72.29	54.76	31.16	35.19
γ 39.0	62.29	46.68	26.74	30.15
γ 40.0	53.19	39.45	23.19	26.23
γ 41.0	45.57	33.61	20.45	23.18
γ 42.0	39.11	28.89	18.25	20.69
γ 43.0	33.74	25.24	16.47	18.77
γ 44.0	29.54	22.43	15.02	17.17
γ 45.0	26.22	20.29	13.82	15.80
γ 46.0	23.62	18.49	12.76	14.65

IES Indoor Report

Photometric Filename: TR05-10-C5-01 RA90 4000K 36D.IES

Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 47.0	21.46	16.91	11.77	13.59
γ 48.0	19.66	15.47	10.78	12.60
γ 49.0	18.04	14.07	10.01	11.64
γ 50.0	16.40	12.67	9.42	10.96
γ 51.0	14.65	11.38	8.92	10.39
γ 52.0	13.37	10.55	8.45	9.87
γ 53.0	12.49	9.82	8.04	9.41
γ 54.0	11.68	9.14	7.62	8.98
γ 55.0	10.96	8.57	7.24	8.59
γ 56.0	10.31	8.04	6.92	8.24
γ 57.0	9.75	7.59	6.59	7.91
γ 58.0	9.23	7.18	6.28	7.58
γ 59.0	8.75	6.79	5.99	7.25
γ 60.0	8.28	6.40	5.67	6.92
γ 61.0	7.86	6.04	5.36	6.57
γ 62.0	7.41	5.68	5.04	6.24
γ 63.0	7.00	5.31	4.73	5.91
γ 64.0	6.60	4.92	4.39	5.57
γ 65.0	6.18	4.58	4.03	5.20
γ 66.0	5.82	4.25	3.66	4.79
γ 67.0	5.41	3.89	3.29	4.38
γ 68.0	5.00	3.50	2.94	4.02
γ 69.0	4.55	3.12	2.60	3.64
γ 70.0	4.13	2.77	2.28	3.31
γ 71.0	3.75	2.42	1.96	2.98
γ 72.0	3.39	2.11	1.66	2.63
γ 73.0	3.04	1.80	1.35	2.31
γ 74.0	2.70	1.50	1.06	2.00
γ 75.0	2.38	1.22	0.79	1.69
γ 76.0	2.07	0.94	0.50	1.40
γ 77.0	1.77	0.68	0.25	1.11
γ 78.0	1.49	0.41	0.00	0.83
γ 79.0	1.21	0.17	0.00	0.56
γ 80.0	0.94	0.00	0.00	0.29
γ 81.0	0.68	0.00	0.00	0.04
γ 82.0	0.42	0.00	0.00	0.00
γ 83.0	0.17	0.00	0.00	0.00
γ 84.0	0.00	0.00	0.00	0.00
γ 85.0	0.00	0.00	0.00	0.00
γ 86.0	0.00	0.00	0.00	0.00
γ 87.0	0.00	0.00	0.00	0.00
γ 88.0	0.00	0.00	0.00	0.00
γ 89.0	0.00	0.00	0.00	0.00
γ 90.0	0.00	0.00	0.00	0.00
γ 91.0	0.00	0.00	0.00	0.00
γ 92.0	0.00	0.00	0.00	0.00
γ 93.0	0.00	0.00	0.00	0.00

IES Indoor Report

Photometric Filename: TR05-10-C5-01 RA90 4000K 36D.IES

Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 94.0	0.00	0.00	0.00	0.00
γ 95.0	0.00	0.00	0.00	0.00
γ 96.0	0.00	0.00	0.00	0.00
γ 97.0	0.00	0.00	0.00	0.00
γ 98.0	0.00	0.00	0.00	0.00
γ 99.0	0.00	0.00	0.00	0.00
γ 100.0	0.00	0.00	0.00	0.00
γ 101.0	0.00	0.00	0.00	0.00
γ 102.0	0.00	0.00	0.00	0.00
γ 103.0	0.00	0.00	0.00	0.00
γ 104.0	0.00	0.00	0.00	0.00
γ 105.0	0.00	0.00	0.00	0.00
γ 106.0	0.00	0.00	0.00	0.00
γ 107.0	0.00	0.00	0.00	0.00
γ 108.0	0.00	0.00	0.00	0.00
γ 109.0	0.00	0.00	0.00	0.00
γ 110.0	0.00	0.00	0.00	0.00
γ 111.0	0.00	0.00	0.00	0.00
γ 112.0	0.00	0.00	0.00	0.00
γ 113.0	0.00	0.00	0.00	0.00
γ 114.0	0.00	0.00	0.00	0.00
γ 115.0	0.00	0.00	0.00	0.00
γ 116.0	0.00	0.00	0.00	0.00
γ 117.0	0.00	0.00	0.00	0.00
γ 118.0	0.00	0.00	0.00	0.00
γ 119.0	0.00	0.00	0.00	0.00
γ 120.0	0.00	0.00	0.00	0.00
γ 121.0	0.00	0.00	0.00	0.00
γ 122.0	0.00	0.00	0.00	0.00
γ 123.0	0.00	0.00	0.00	0.00
γ 124.0	0.00	0.00	0.00	0.00
γ 125.0	0.00	0.00	0.00	0.00
γ 126.0	0.00	0.00	0.00	0.00
γ 127.0	0.00	0.00	0.00	0.00
γ 128.0	0.00	0.00	0.00	0.00
γ 129.0	0.00	0.00	0.00	0.00
γ 130.0	0.00	0.00	0.00	0.00
γ 131.0	0.00	0.00	0.00	0.00
γ 132.0	0.00	0.00	0.00	0.00
γ 133.0	0.00	0.00	0.00	0.00
γ 134.0	0.00	0.00	0.00	0.00
γ 135.0	0.00	0.00	0.00	0.00
γ 136.0	0.00	0.00	0.00	0.00
γ 137.0	0.00	0.00	0.00	0.00
γ 138.0	0.00	0.00	0.00	0.00
γ 139.0	0.00	0.00	0.00	0.00
γ 140.0	0.00	0.00	0.00	0.00

IES Indoor Report

Photometric Filename: TR05-10-C5-01 RA90 4000K 36D.IES

Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 141.0	0.00	0.00	0.00	0.00
γ 142.0	0.00	0.00	0.00	0.00
γ 143.0	0.00	0.00	0.00	0.00
γ 144.0	0.00	0.00	0.00	0.00
γ 145.0	0.00	0.00	0.00	0.00
γ 146.0	0.00	0.00	0.00	0.00
γ 147.0	0.00	0.00	0.00	0.00
γ 148.0	0.00	0.00	0.00	0.00
γ 149.0	0.00	0.00	0.06	0.00
γ 150.0	0.00	0.00	0.15	0.09
γ 151.0	0.00	0.00	0.23	0.16
γ 152.0	0.00	0.00	0.31	0.24
γ 153.0	0.00	0.00	0.38	0.31
γ 154.0	0.00	0.00	0.44	0.38
γ 155.0	0.03	0.00	0.52	0.44
γ 156.0	0.10	0.02	0.57	0.49
γ 157.0	0.18	0.10	0.62	0.54
γ 158.0	0.25	0.16	0.67	0.58
γ 159.0	0.31	0.23	0.70	0.63
γ 160.0	0.38	0.29	0.73	0.65
γ 161.0	0.43	0.34	0.75	0.67
γ 162.0	0.49	0.38	0.76	0.69
γ 163.0	0.53	0.42	0.79	0.71
γ 164.0	0.57	0.45	0.79	0.73
γ 165.0	0.60	0.47	0.80	0.73
γ 166.0	0.63	0.51	0.79	0.73
γ 167.0	0.65	0.52	0.79	0.73
γ 168.0	0.67	0.54	0.81	0.73
γ 169.0	0.69	0.56	0.81	0.74
γ 170.0	0.70	0.58	0.81	0.73
γ 171.0	0.72	0.59	0.83	0.74
γ 172.0	0.73	0.61	0.82	0.76
γ 173.0	0.74	0.62	0.85	0.76
γ 174.0	0.76	0.64	0.85	0.77
γ 175.0	0.78	0.66	0.85	0.79
γ 176.0	0.79	0.68	0.87	0.81
γ 177.0	0.81	0.69	0.87	0.82
γ 178.0	0.82	0.71	0.88	0.82
γ 179.0	0.84	0.73	0.86	0.83
γ 180.0	0.83	0.83	0.83	0.83
