

# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES



## Indoor Luminaire Photometric Data

### Description Information

Luminary Name:DL44-10-C5-05 3000K RA80 40D		Lum. Catalog:	Test ID: 01
Lamp Name:		Lamp Catalog: LED	Test Date: 2020/12/10
Manufacture: Shenzhen Norming Lighting Co.Ltd		Shld.Ang(°):	Test Machine:GON-2000
Test Lab: Quality Department		Frequency(Hz):	Lamp CCT(K): Ra:
Lum. Size(W*L*H):0.000m*0.000m*0.000m		Lum. Area(m2):0.000	Lum. W(kg): 0.000
Test System: C, γ	Test Step: C=90.0 γ=1.0	Temp.(°C): 25	Humidity(%): 50.0

### Character Parameter

Lamp Speciality Parameter		Luminaire Speciality Parameter	
Rated Flux(lm): 671.920	Luminary Flux(lm): 671.920	Field Angle(10%Imax): 97.4(°)	
Rated Power(W):	Luminary Efficiency: 100.00%	Down Lumens&Percent: 670.245lm 99.75%	
Rated Voltage(V):	Luminary EER(lm/W): 69.227	Up Lumens&Percent: 1.674lm 0.25%	
Tested Power(W): 9.706	Max. Candela(cd): 926.087	S/MH: C0_a180=0.584 C90_270=0.583	
Lamps' Inside: 1	Max Cand@Ang.(°): C=90.0 γ=1.0	CIE Type: Semi-Direct	
Tested Electrics(V, A, pf):240.5, 0.043, 0.919	Beam Angle(50%Imax): 37.0(°)	ErP φ use(90°): 572.243lm	
Lamp Size(W*L*H):0.000m*0.000m*0.000m	Left=-17.3°, Right=19.7°	IRF(%): 299.736	

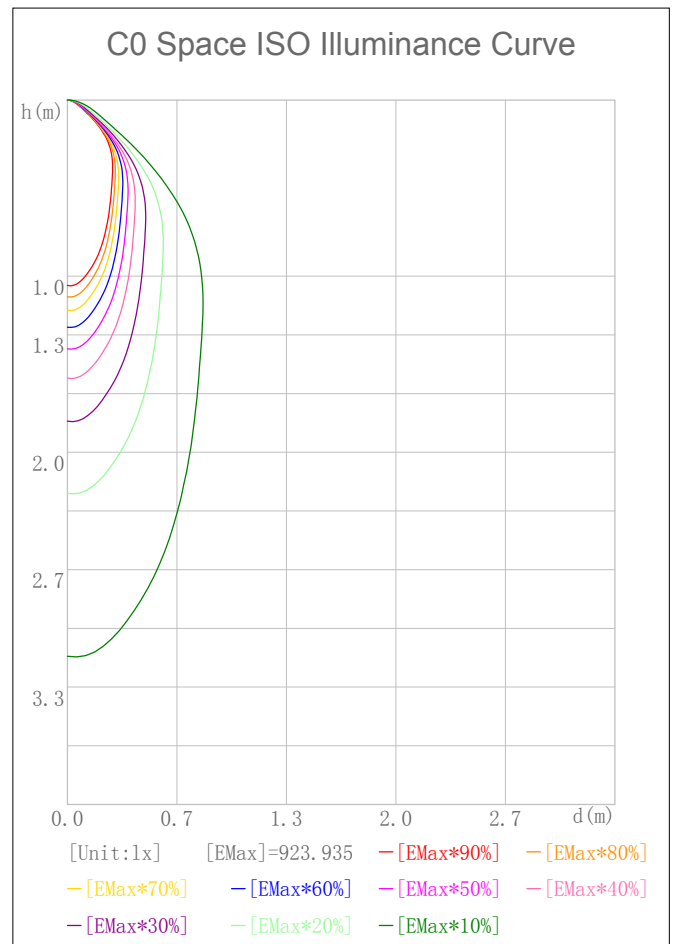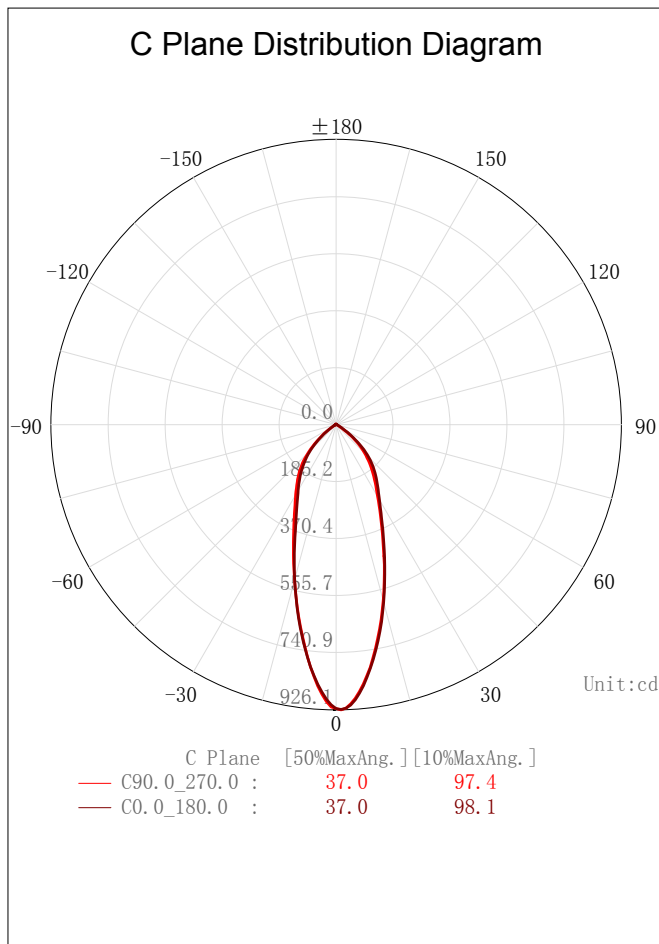



# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

## 2D Plane Light Intensity Distribution Curve

Lum. Name: DL44-10-C5-05 3000K RA80 40D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/10

C Plane Distribution Diagram

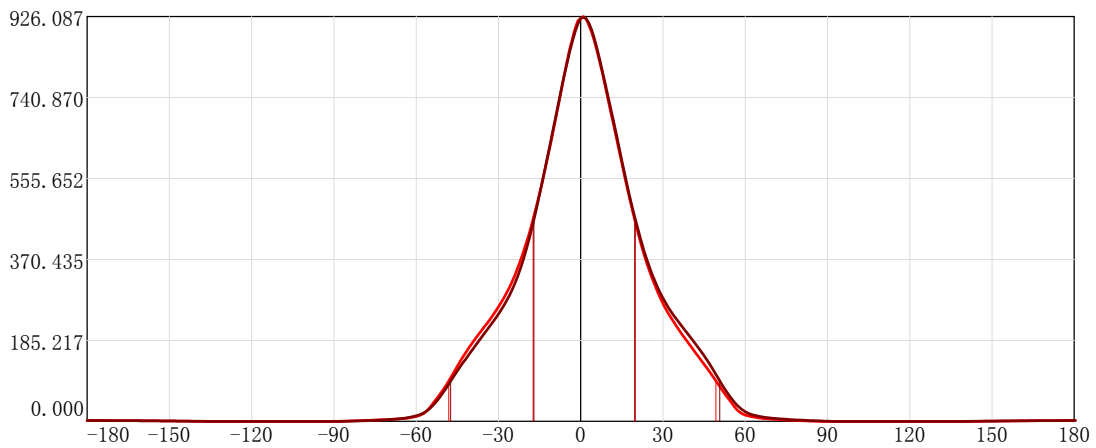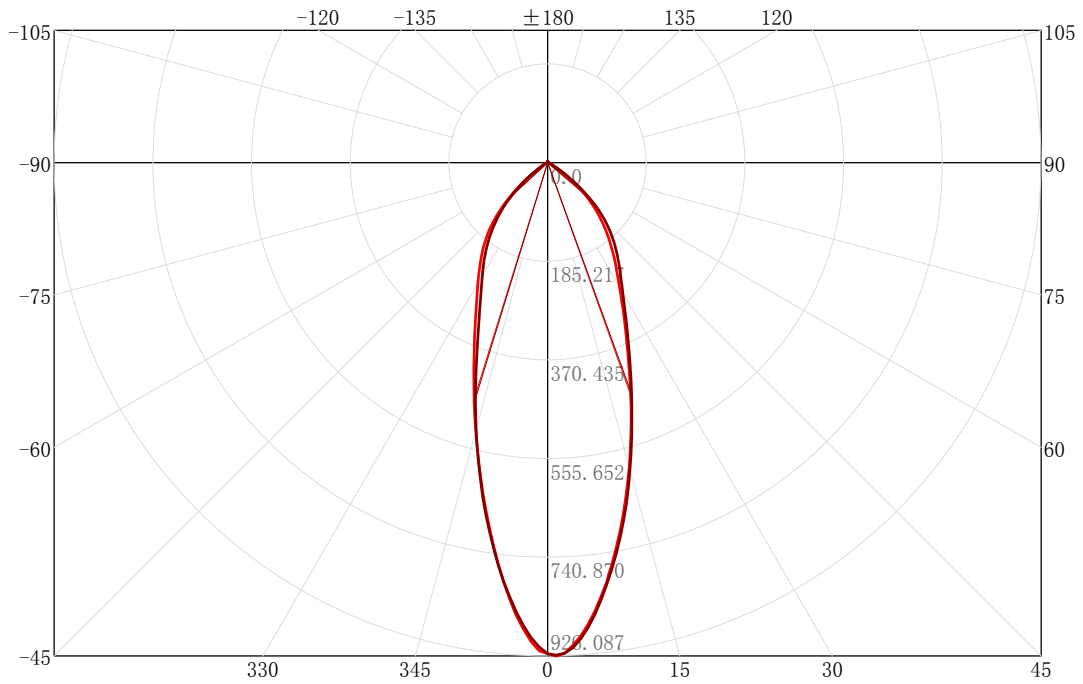

C Plane	[50%MaxAng.]	[10%MaxAng.]
C90.0_270.0	: 37.0	97.4
C0.0_180.0	: 37.0	98.1

Unit:cd

# IES Indoor Report


Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

---

## 3D Light Intensity Distribution Modal

Lum. Name: DL44-10-C5-05 3000K RA80 40D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/10

## 3D Light Intensity Distribution Modal

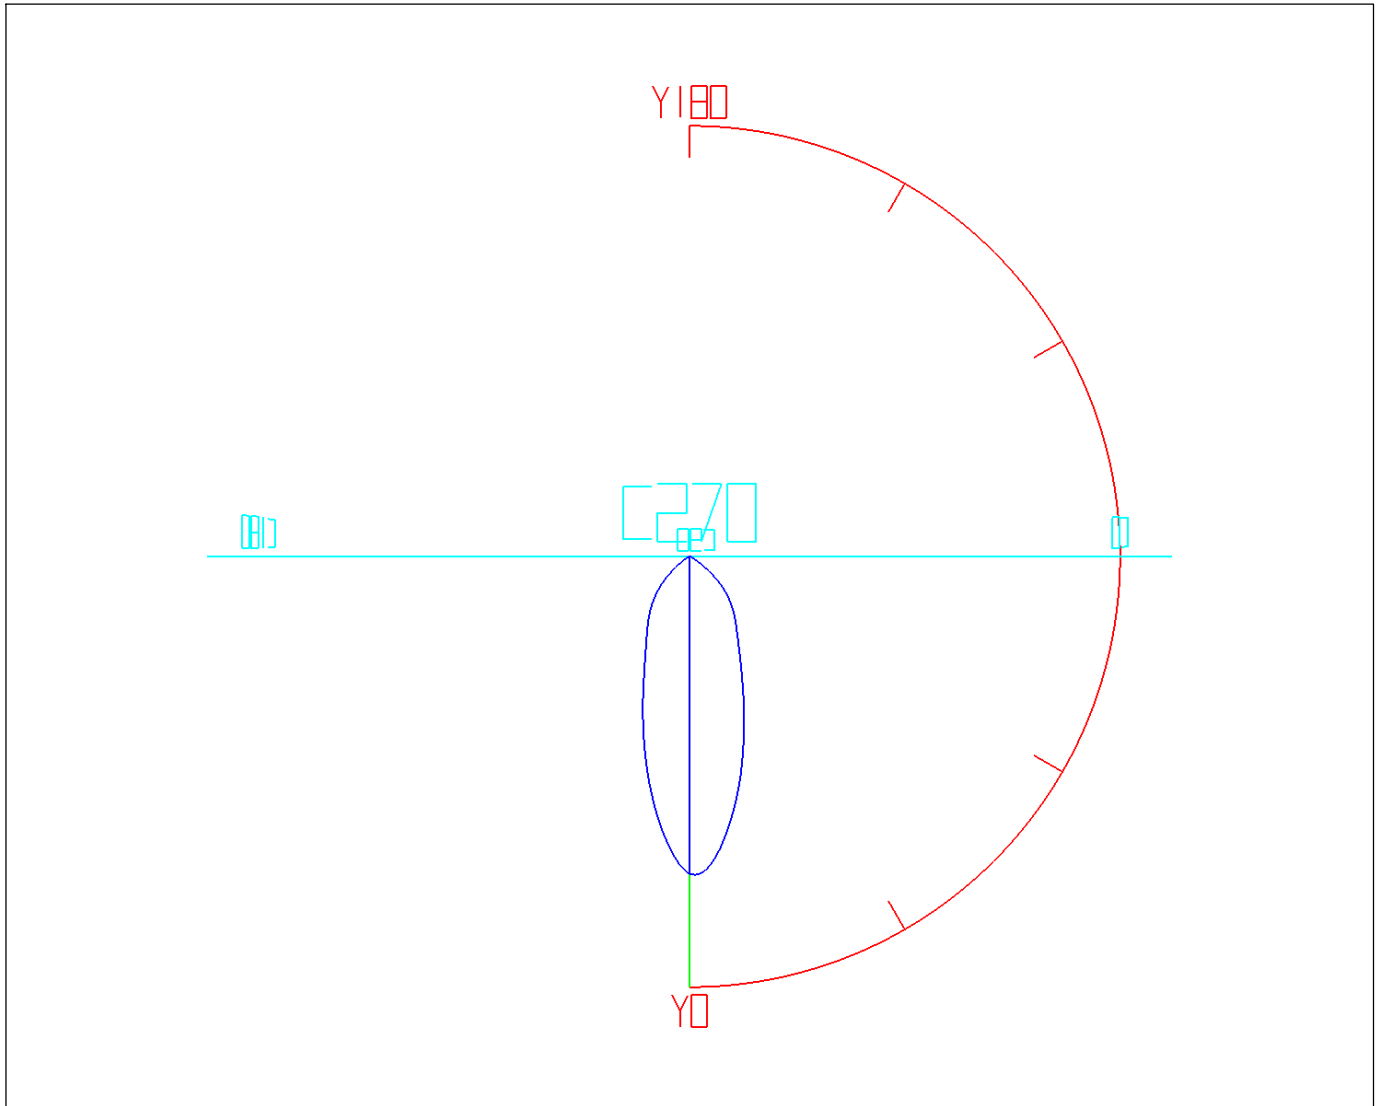

Curves: 3D Model —— Fixture —— Vert. HUD —— Hori. HUD ——  
View Angles: Orient:0 Tilt:0 Roll:0 Spin:0

---

# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

## Zonal Flux Tabulation

Zone( $\gamma$ )	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp	Zone( $\gamma$ )	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp
0.0-1.0	0.88	0.88	0.13	0.13	47.0-48.0	8.62	604.00	1.28	89.89
1.0-2.0	2.62	3.50	0.39	0.52	48.0-49.0	7.94	611.95	1.18	91.07
2.0-3.0	4.30	7.81	0.64	1.16	49.0-50.0	7.24	619.19	1.08	92.15
3.0-4.0	5.90	13.70	0.88	2.04	50.0-51.0	6.54	625.73	0.97	93.13
4.0-5.0	7.38	21.09	1.10	3.14	51.0-52.0	5.84	631.57	0.87	93.99
5.0-6.0	8.76	29.84	1.30	4.44	52.0-53.0	5.16	636.73	0.77	94.76
6.0-7.0	10.00	39.85	1.49	5.93	53.0-54.0	4.49	641.22	0.67	95.43
7.0-8.0	11.13	50.97	1.66	7.59	54.0-55.0	3.84	645.06	0.57	96.00
8.0-9.0	12.13	63.10	1.80	9.39	55.0-56.0	3.22	648.28	0.48	96.48
9.0-10.0	13.00	76.10	1.94	11.33	56.0-57.0	2.66	650.94	0.40	96.88
10.0-11.0	13.77	89.87	2.05	13.38	57.0-58.0	2.19	653.13	0.33	97.20
11.0-12.0	14.41	104.28	2.14	15.52	58.0-59.0	1.84	654.97	0.27	97.48
12.0-13.0	14.94	119.22	2.22	17.74	59.0-60.0	1.57	656.54	0.23	97.71
13.0-14.0	15.36	134.58	2.29	20.03	60.0-61.0	1.37	657.91	0.20	97.91
14.0-15.0	15.68	150.26	2.33	22.36	61.0-62.0	1.21	659.11	0.18	98.09
15.0-16.0	15.91	166.17	2.37	24.73	62.0-63.0	1.07	660.19	0.16	98.25
16.0-17.0	16.05	182.23	2.39	27.12	63.0-64.0	0.96	661.15	0.14	98.40
17.0-18.0	16.12	198.35	2.40	29.52	64.0-65.0	0.87	662.02	0.13	98.53
18.0-19.0	16.12	214.47	2.40	31.92	65.0-66.0	0.79	662.81	0.12	98.64
19.0-20.0	16.07	230.54	2.39	34.31	66.0-67.0	0.72	663.53	0.11	98.75
20.0-21.0	15.97	246.51	2.38	36.69	67.0-68.0	0.67	664.19	0.10	98.85
21.0-22.0	15.85	262.36	2.36	39.05	68.0-69.0	0.61	664.81	0.09	98.94
22.0-23.0	15.71	278.06	2.34	41.38	69.0-70.0	0.57	665.38	0.08	99.03
23.0-24.0	15.55	293.62	2.31	43.70	70.0-71.0	0.53	665.90	0.08	99.10
24.0-25.0	15.40	309.02	2.29	45.99	71.0-72.0	0.49	666.39	0.07	99.18
25.0-26.0	15.25	324.27	2.27	48.26	72.0-73.0	0.45	666.84	0.07	99.24
26.0-27.0	15.08	339.35	2.24	50.50	73.0-74.0	0.42	667.26	0.06	99.31
27.0-28.0	14.91	354.26	2.22	52.72	74.0-75.0	0.39	667.65	0.06	99.36
28.0-29.0	14.75	369.01	2.20	54.92	75.0-76.0	0.36	668.01	0.05	99.42
29.0-30.0	14.60	383.61	2.17	57.09	76.0-77.0	0.33	668.33	0.05	99.47
30.0-31.0	14.44	398.05	2.15	59.24	77.0-78.0	0.30	668.63	0.04	99.51
31.0-32.0	14.29	412.34	2.13	61.37	78.0-79.0	0.27	668.89	0.04	99.55
32.0-33.0	14.13	426.47	2.10	63.47	79.0-80.0	0.24	669.13	0.04	99.59
33.0-34.0	13.97	440.44	2.08	65.55	80.0-81.0	0.21	669.35	0.03	99.62
34.0-35.0	13.79	454.23	2.05	67.60	81.0-82.0	0.19	669.54	0.03	99.65
35.0-36.0	13.58	467.81	2.02	69.62	82.0-83.0	0.16	669.70	0.02	99.67
36.0-37.0	13.36	481.16	1.99	71.61	83.0-84.0	0.14	669.84	0.02	99.69
37.0-38.0	13.11	494.27	1.95	73.56	84.0-85.0	0.12	669.96	0.02	99.71
38.0-39.0	12.83	507.10	1.91	75.47	85.0-86.0	0.10	670.05	0.01	99.72
39.0-40.0	12.53	519.63	1.86	77.33	86.0-87.0	0.07	670.13	0.01	99.73
40.0-41.0	12.18	531.81	1.81	79.15	87.0-88.0	0.05	670.18	0.01	99.74
41.0-42.0	11.79	543.60	1.76	80.90	88.0-89.0	0.04	670.22	0.01	99.75
42.0-43.0	11.37	554.97	1.69	82.59	89.0-90.0	0.03	670.25	0.00	99.75
43.0-44.0	10.90	565.87	1.62	84.22	90.0-91.0	0.02	670.26	0.00	99.75
44.0-45.0	10.40	576.27	1.55	85.76	91.0-92.0	0.01	670.27	0.00	99.75
45.0-46.0	9.85	586.12	1.47	87.23	92.0-93.0	0.00	670.28	0.00	99.76
46.0-47.0	9.26	595.38	1.38	88.61	93.0-94.0	0.00	670.28	0.00	99.76

# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

## Zonal Flux Tabulation - (Cont.)

Zone( $\gamma$ )	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp	Zone( $\gamma$ )	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp
94.0-95.0	0.00	670.28	0.00	99.76	141.0-142.0	0.02	670.38	0.00	99.77
95.0-96.0	0.00	670.28	0.00	99.76	142.0-143.0	0.03	670.40	0.00	99.77
96.0-97.0	0.00	670.28	0.00	99.76	143.0-144.0	0.03	670.44	0.00	99.78
97.0-98.0	0.00	670.28	0.00	99.76	144.0-145.0	0.03	670.47	0.01	99.78
98.0-99.0	0.00	670.28	0.00	99.76	145.0-146.0	0.04	670.51	0.01	99.79
99.0-100.0	0.00	670.28	0.00	99.76	146.0-147.0	0.04	670.55	0.01	99.80
100.0-101.0	0.00	670.28	0.00	99.76	147.0-148.0	0.04	670.59	0.01	99.80
101.0-102.0	0.00	670.28	0.00	99.76	148.0-149.0	0.05	670.64	0.01	99.81
102.0-103.0	0.00	670.28	0.00	99.76	149.0-150.0	0.05	670.69	0.01	99.82
103.0-104.0	0.00	670.28	0.00	99.76	150.0-151.0	0.05	670.74	0.01	99.82
104.0-105.0	0.00	670.28	0.00	99.76	151.0-152.0	0.05	670.80	0.01	99.83
105.0-106.0	0.00	670.28	0.00	99.76	152.0-153.0	0.06	670.85	0.01	99.84
106.0-107.0	0.00	670.28	0.00	99.76	153.0-154.0	0.06	670.91	0.01	99.85
107.0-108.0	0.00	670.28	0.00	99.76	154.0-155.0	0.06	670.96	0.01	99.86
108.0-109.0	0.00	670.28	0.00	99.76	155.0-156.0	0.06	671.02	0.01	99.87
109.0-110.0	0.00	670.28	0.00	99.76	156.0-157.0	0.06	671.08	0.01	99.87
110.0-111.0	0.00	670.28	0.00	99.76	157.0-158.0	0.06	671.14	0.01	99.88
111.0-112.0	0.00	670.28	0.00	99.76	158.0-159.0	0.06	671.20	0.01	99.89
112.0-113.0	0.00	670.28	0.00	99.76	159.0-160.0	0.06	671.25	0.01	99.90
113.0-114.0	0.00	670.28	0.00	99.76	160.0-161.0	0.06	671.31	0.01	99.91
114.0-115.0	0.00	670.28	0.00	99.76	161.0-162.0	0.05	671.36	0.01	99.92
115.0-116.0	0.00	670.28	0.00	99.76	162.0-163.0	0.05	671.42	0.01	99.93
116.0-117.0	0.00	670.28	0.00	99.76	163.0-164.0	0.05	671.47	0.01	99.93
117.0-118.0	0.00	670.28	0.00	99.76	164.0-165.0	0.05	671.52	0.01	99.94
118.0-119.0	0.00	670.28	0.00	99.76	165.0-166.0	0.05	671.57	0.01	99.95
119.0-120.0	0.00	670.28	0.00	99.76	166.0-167.0	0.05	671.61	0.01	99.95
120.0-121.0	0.00	670.28	0.00	99.76	167.0-168.0	0.04	671.65	0.01	99.96
121.0-122.0	0.00	670.28	0.00	99.76	168.0-169.0	0.04	671.70	0.01	99.97
122.0-123.0	0.00	670.28	0.00	99.76	169.0-170.0	0.04	671.73	0.01	99.97
123.0-124.0	0.00	670.28	0.00	99.76	170.0-171.0	0.03	671.77	0.01	99.98
124.0-125.0	0.00	670.28	0.00	99.76	171.0-172.0	0.03	671.80	0.00	99.98
125.0-126.0	0.00	670.28	0.00	99.76	172.0-173.0	0.03	671.83	0.00	99.99
126.0-127.0	0.00	670.28	0.00	99.76	173.0-174.0	0.02	671.85	0.00	99.99
127.0-128.0	0.00	670.28	0.00	99.76	174.0-175.0	0.02	671.87	0.00	99.99
128.0-129.0	0.00	670.28	0.00	99.76	175.0-176.0	0.02	671.89	0.00	100.00
129.0-130.0	0.00	670.28	0.00	99.76	176.0-177.0	0.01	671.90	0.00	100.00
130.0-131.0	0.00	670.28	0.00	99.76	177.0-178.0	0.01	671.91	0.00	100.00
131.0-132.0	0.00	670.28	0.00	99.76	178.0-179.0	0.01	671.92	0.00	100.00
132.0-133.0	0.00	670.28	0.00	99.76	179.0-180.0	0.00	671.92	0.00	100.00
133.0-134.0	0.00	670.28	0.00	99.76					
134.0-135.0	0.00	670.28	0.00	99.76					
135.0-136.0	0.00	670.29	0.00	99.76					
136.0-137.0	0.01	670.29	0.00	99.76					
137.0-138.0	0.01	670.30	0.00	99.76					
138.0-139.0	0.01	670.32	0.00	99.76					
139.0-140.0	0.02	670.33	0.00	99.76					
140.0-141.0	0.02	670.35	0.00	99.77					


# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

## Rectangle ISO Lighting Intensity Diagram

Lum. Name: DL44-10-C5-05 3000K RA80 40D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/10

### ISO Lighting Intensity Curve

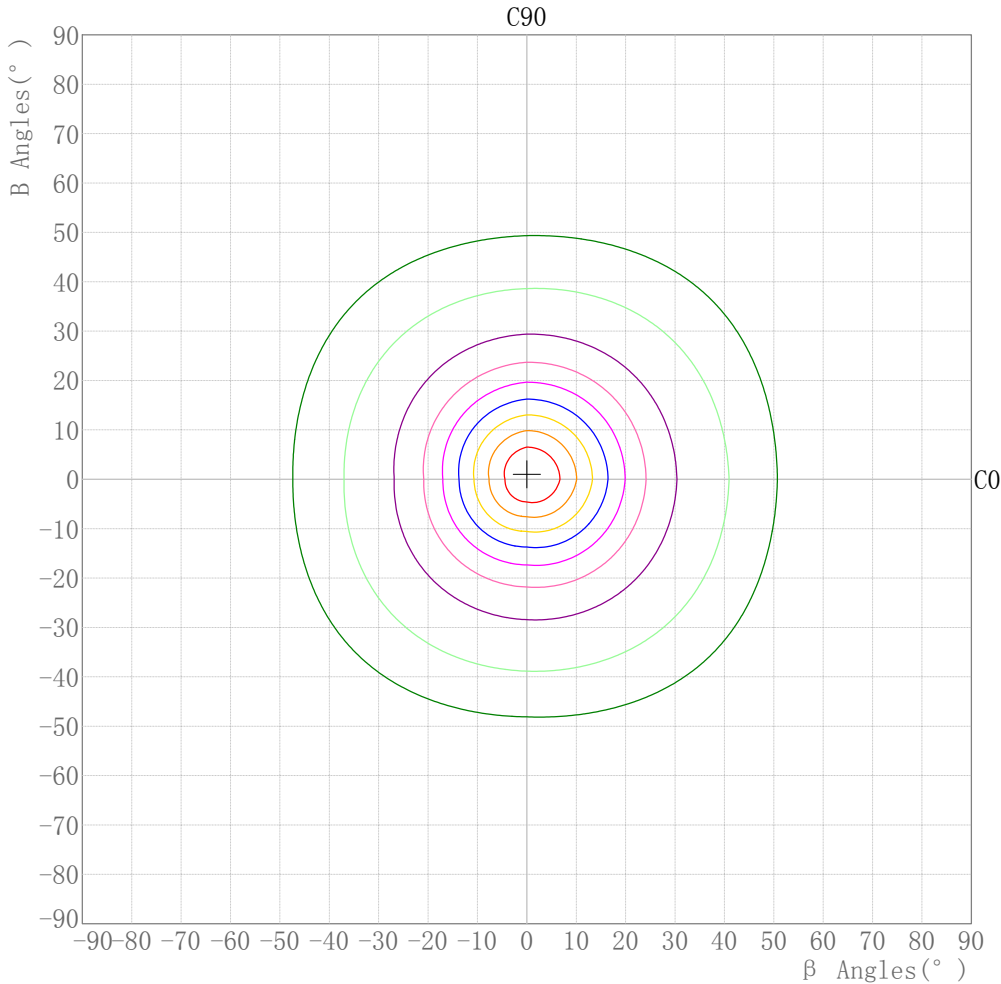

Maximum Light Intensity(cd): 926.09

Maximum Cand.@Angle: H=0.0°,V=1.0°


# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

## Plane ISO-Illuminance Diagram

Lum. Name: DL44-10-C5-05 3000K RA80 40D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/10

### Plane ISO-Illuminance Curve

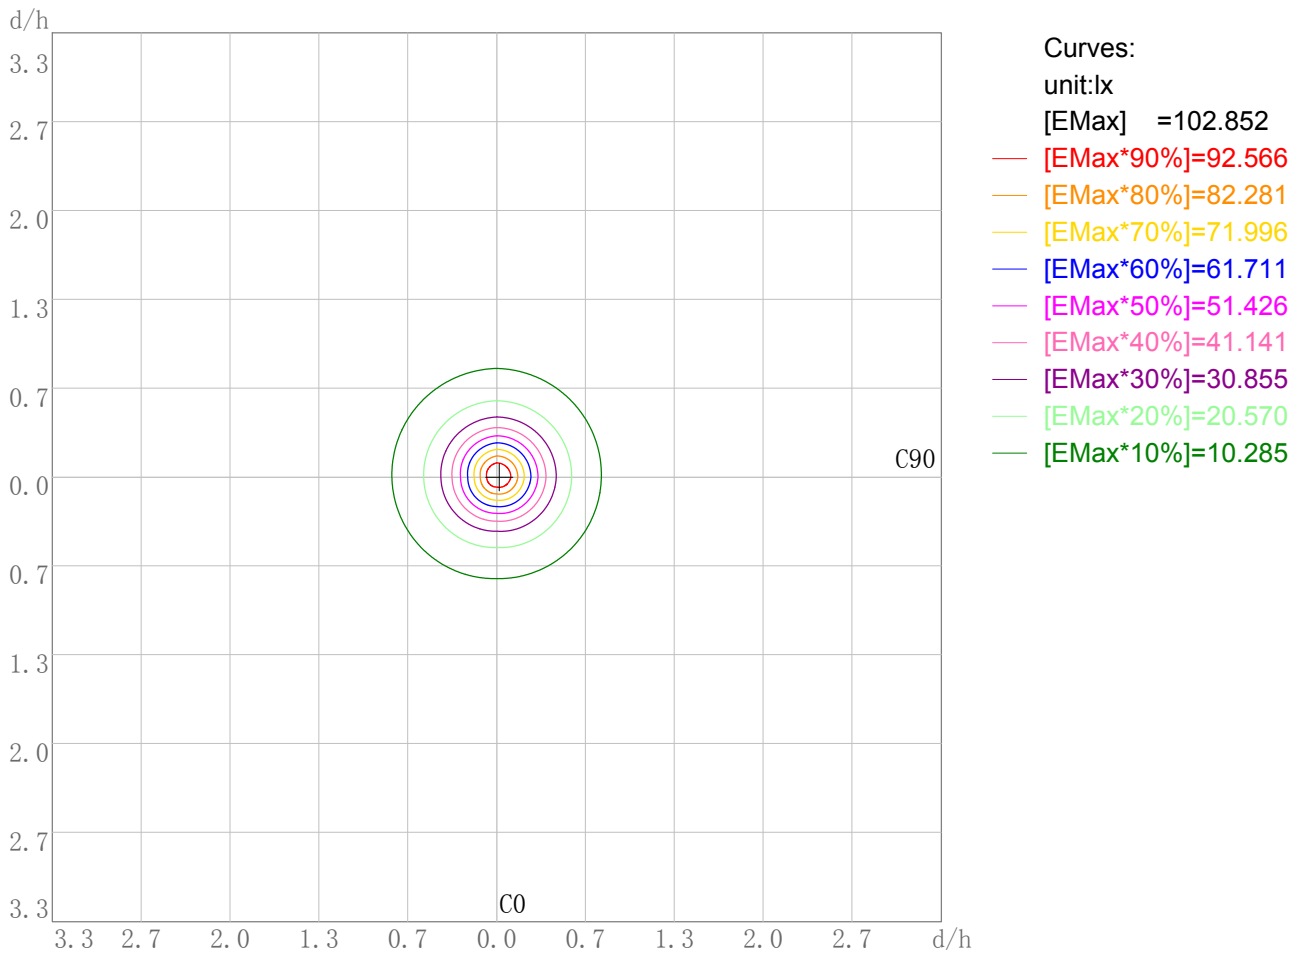

Working Plane Luminaire Mounting Height(m): 3.00

Working Plane Maximum Illuminance(lx): 102.85

Working Plane Maximum Illuminance Position(d/h):H0.0 V0.0


# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

## 3D Plane ISO Illuminance Diagram

Lum. Name: DL44-10-C5-05 3000K RA80 40D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/10

### 3D Plane Illuminance Modal

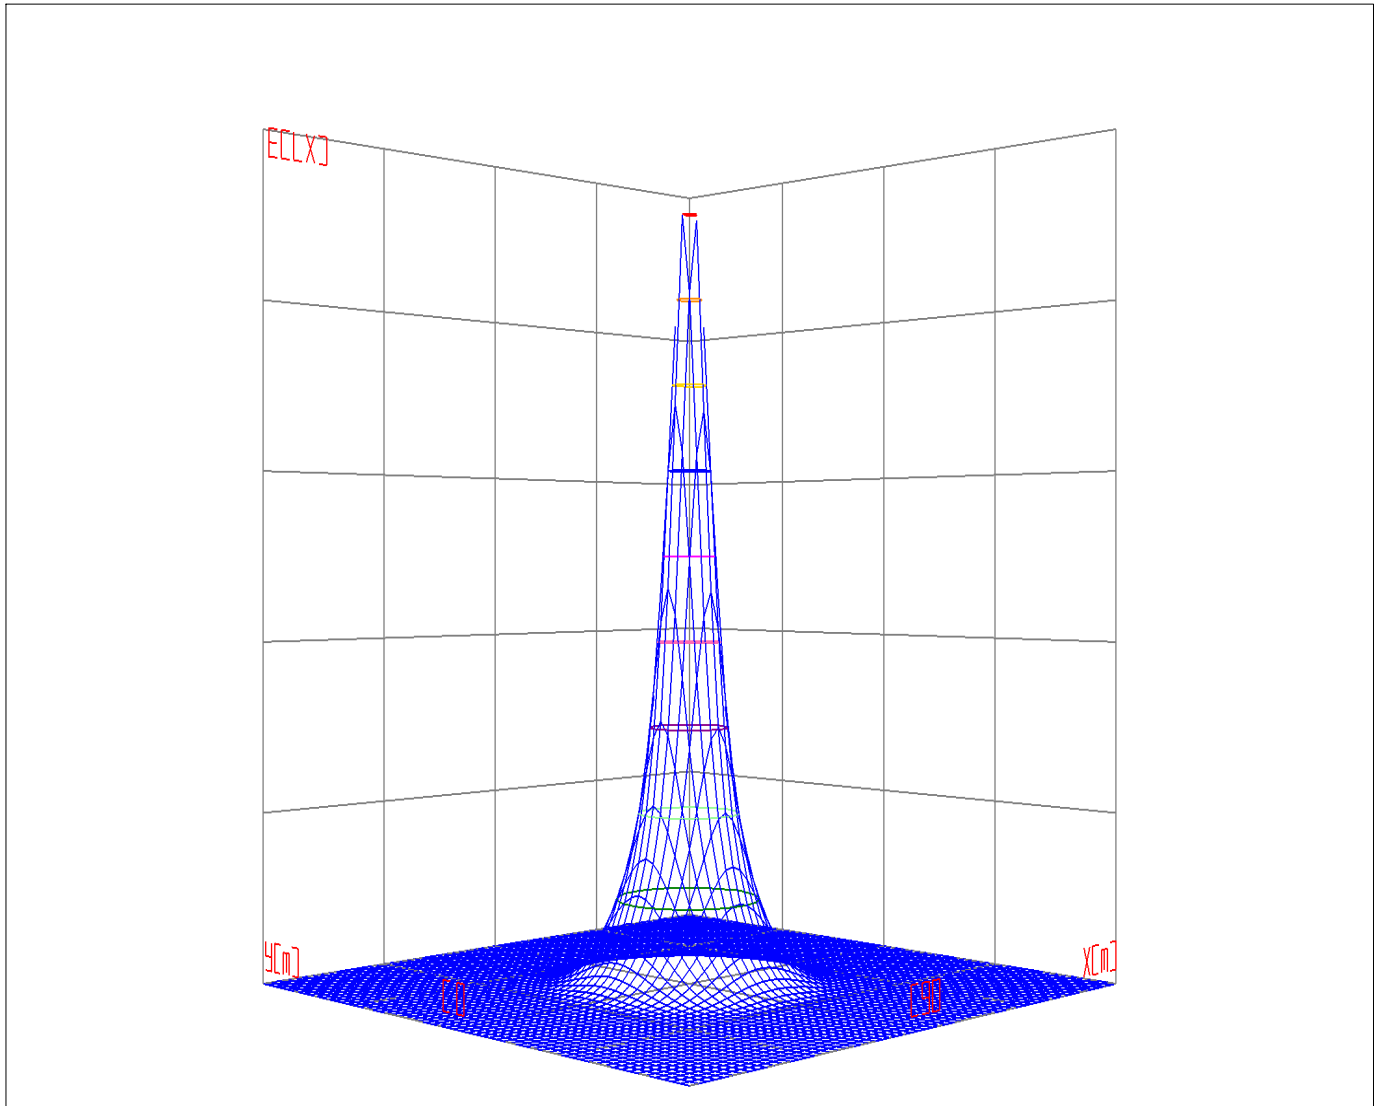

Curves: 3D Model — 90% — 80% — 70% — 60% — 50% — 40% — 30% — 20% — 10% —  
View Angles(deg): 0 Height(m): 3.0 Distance(m): 10.0



# IES Indoor Report


Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

---

## Space ISO Illuminance Diagram

Lum. Name: DL44-10-C5-05 3000K RA80 40D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/10

Space ISO Illuminance Curve

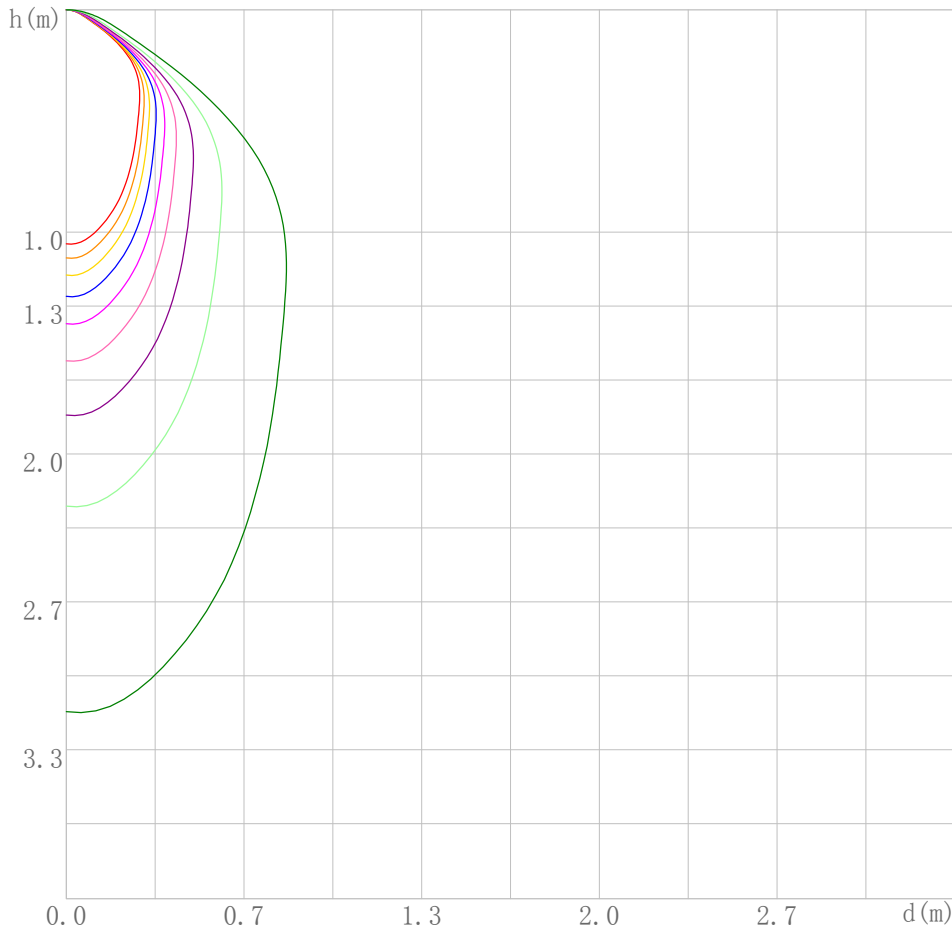

Curves:

[Unit: lx]

[EMax] =923.935

— [EMax\*90%]=831.541

— [EMax\*80%]=739.148

— [EMax\*70%]=646.754

— [EMax\*60%]=554.361

— [EMax\*50%]=461.967

— [EMax\*40%]=369.574

— [EMax\*30%]=277.180

— [EMax\*20%]=184.787

— [EMax\*10%]=92.393

Space Plane Maximum Illuminance and @Angle:923.93lx,1.0deg  
Plane Maximum Lighting Intensity and @Angle:924.357cd,0deg

---


# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

## Illuminance-Distance Diagram

Lum. Name: DL44-10-C5-05 3000K RA80 40D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/10

Illuminance-Distance Curve

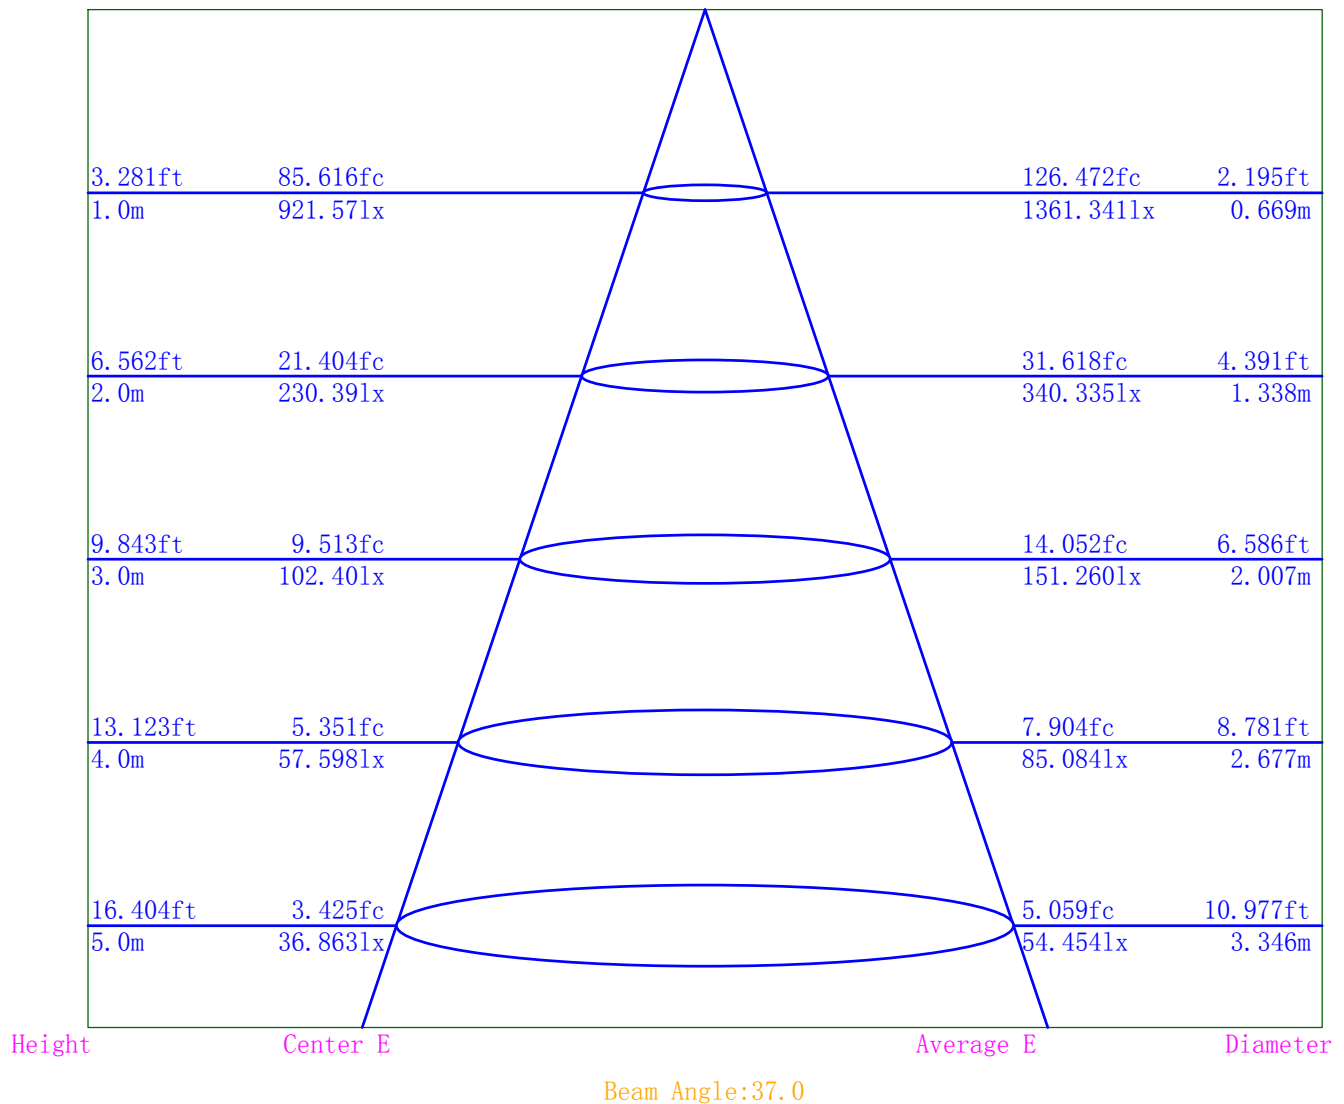

**Indoor Luminance Limiting Curves**

Lum. Name: DL44-10-C5-05 3000K RA80 40D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/10


Glare Grade Table

GI	Quality	Using Illuminance							
		a	b	c	d	e	f	g	h
1.15	A	2000	1000	500	<=300				
1.5	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.2	D				2000	1000	500	<=300	
2.55	E	a				2000	1000	500	<=300
			b	c	d	e	f	g	h

Luminance Table

Gama (deg)	45	50	55	60	65	70	75	80	85
C0	0	0	0	0	0	0	0	0	0
C90	0	0	0	0	0	0	0	0	0

Luminance Limiting Curve

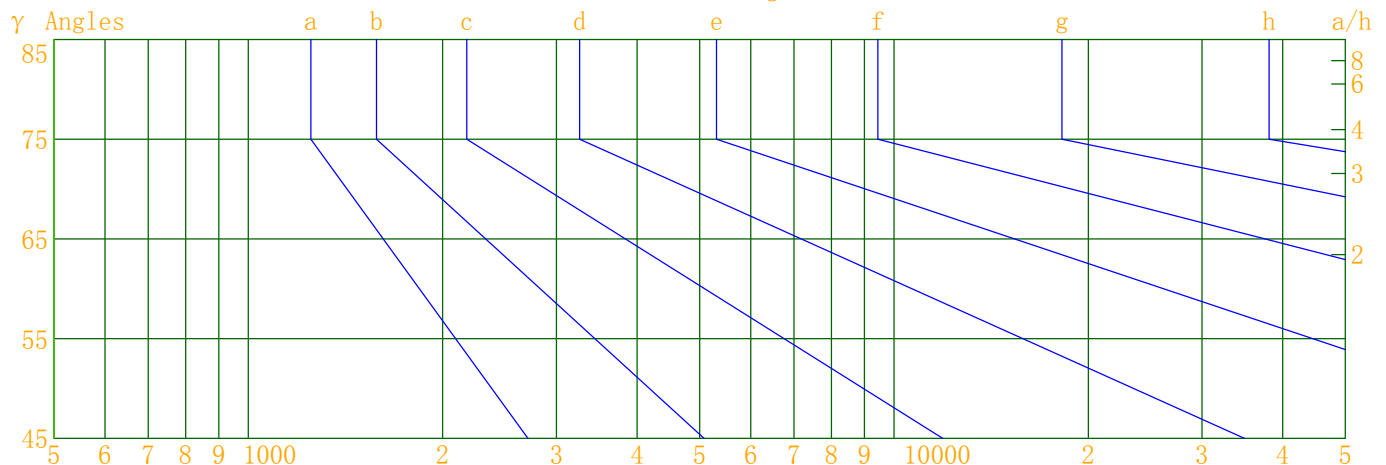


Luminous Size: Length(m)=0.000 Width(m)=0.000 Height(m)=0.000 Area(m^2)=0.000000  
 Luminous Type: Without Luminous Side  
 Luminous Curves: C0-C180 Color: — C90-C270 Color: —

# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

## Indoor Budgetary Estimate Table

Lum. Name: DL44-10-C5-05 3000K RA80 40D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/10

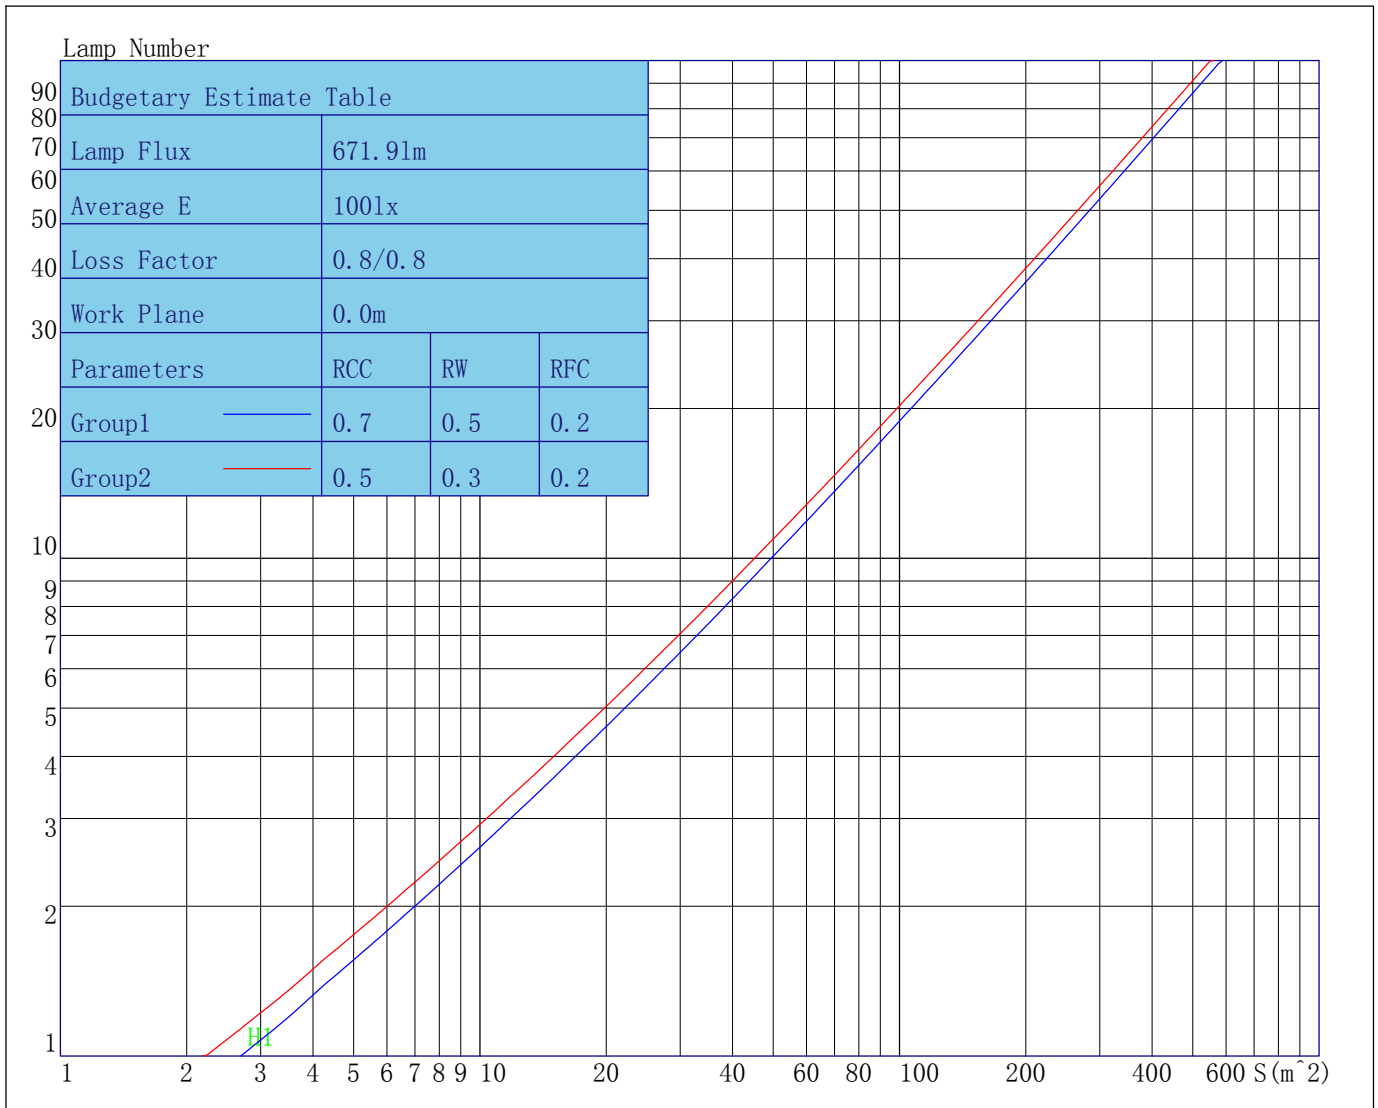

Parameters1: Rhocc = 0.7 Rhow = 0.5 Rhofc = 0.2 LLF = 0.8  
 Parameters2: Rhocc = 0.5 Rhow = 0.3 Rhofc = 0.2 LLF = 0.8  
 Average Illuminance(lx): 100 Cavity Height: H1(m) = 2

# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

## Indoor Coefficient of Utilization Table

Lum. Name: DL44-10-C5-05 3000K RA80 40D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/10

Coefficients of Utilization - Zonal Cavity Method																					
Coef.	Effective Floor Cavity Reflectance RFC=0.20																				
RhoCC (%)	80				70				50				30				10				0
RhoW (%)	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0			
RCR	Coefficient of Utilization(%)																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	110	107	104	110	107	105	103	103	101	99	100	98	96	96	95	94	92			
2	106	101	96	92	104	99	95	91	96	92	89	93	90	87	90	88	85	84			
3	100	93	87	83	98	91	86	82	89	84	81	86	83	79	84	81	78	76			
4	94	86	80	75	92	85	79	74	82	77	74	80	76	73	78	75	72	70			
5	89	80	73	68	87	79	72	68	77	71	67	75	70	67	73	69	66	64			
6	84	74	67	63	82	73	67	62	72	66	62	70	65	61	69	64	61	59			
7	79	69	62	58	78	68	62	58	67	61	57	66	61	57	65	60	57	55			
8	75	65	58	54	74	64	58	54	63	57	53	62	57	53	61	56	53	51			
9	71	61	54	50	70	60	54	50	59	54	50	58	53	50	57	53	49	48			
10	68	57	51	47	67	57	51	47	56	50	47	55	50	46	54	50	46	45			

# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

## Unified Glare Rating Table

Lum. Name: DL44-10-C5-05 3000K RA80 40D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co.Ltd	Test Machine:GON-2000	Test Date: 2020/12/10

## Unified Glare Rating Table

Ceiling RCC	0.70	0.70	0.50	0.50	0.30	0.70	0.70	0.50	0.50	0.30
Wall RW	0.50	0.30	0.50	0.30	0.30	0.50	0.30	0.50	0.30	0.30
Floor RFC	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20
Room Size	Vewed crosswise					Vewed endwise				
X=2H Y=2H	-2.5	-1.3	-2.2	-1.0	-0.7	-2.5	-1.3	-2.2	-1.0	-0.7
Y=3H	-2.7	-1.6	-2.3	-1.3	-0.9	-2.7	-1.6	-2.3	-1.3	-0.9
Y=4H	-2.8	-1.8	-2.4	-1.4	-1.1	-2.8	-1.8	-2.4	-1.4	-1.1
Y=6H	-2.9	-2.0	-2.4	-1.6	-1.2	-2.9	-2.0	-2.4	-1.6	-1.2
Y=8H	-2.9	-2.1	-2.5	-1.7	-1.3	-2.9	-2.1	-2.5	-1.7	-1.3
Y=12H	-3.0	-2.2	-2.5	-1.8	-1.3	-3.0	-2.2	-2.5	-1.8	-1.3
X=4H Y=2H	-2.8	-1.8	-2.4	-1.4	-1.1	-2.8	-1.8	-2.4	-1.4	-1.1
Y=3H	-2.9	-2.2	-2.5	-1.7	-1.3	-2.9	-2.2	-2.5	-1.7	-1.3
Y=4H	-3.1	-2.4	-2.6	-1.9	-1.5	-3.1	-2.4	-2.6	-1.9	-1.5
Y=6H	-3.2	-2.5	-2.7	-2.1	-1.6	-3.2	-2.5	-2.7	-2.1	-1.6
Y=8H	-3.2	-2.6	-2.7	-2.2	-1.7	-3.2	-2.6	-2.7	-2.2	-1.7
Y=12H	-3.3	-2.8	-2.8	-2.3	-1.8	-3.3	-2.8	-2.8	-2.3	-1.8
X=8H Y=4H	-3.2	-2.6	-2.7	-2.2	-1.7	-3.2	-2.6	-2.7	-2.2	-1.7
Y=6H	-3.3	-2.9	-2.8	-2.4	-1.8	-3.3	-2.9	-2.8	-2.4	-1.8
Y=8H	-3.4	-3.0	-2.9	-2.5	-2.0	-3.4	-3.0	-2.9	-2.5	-2.0
Y=12H	-3.5	-3.1	-2.9	-2.6	-2.0	-3.5	-3.1	-2.9	-2.6	-2.0
X=12H Y=4H	-3.3	-2.8	-2.8	-2.3	-1.8	-3.3	-2.8	-2.8	-2.3	-1.8
Y=6H	-3.4	-3.0	-2.9	-2.5	-2.0	-3.4	-3.0	-2.9	-2.5	-2.0
Y=8H	-3.5	-3.1	-2.9	-2.6	-2.0	-3.5	-3.1	-2.9	-2.6	-2.0
Variations with the objerver position at spacings										
S=1.0H	0.0/0.0					0.0/0.0				
S=1.5H	0.0/0.0					0.0/0.0				
S=2.0H	0.0/0.0					0.0/0.0				
Reduced UGR Table:										
Nordic Standard Table:	BKO					BKO				
Correction Value	0.0					0.0				

to the CIE Pub.117, data has been corrected, refers to the lamp's lumens 8.2flm.

# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

---

## Candela Tabulation

V/H	C0.0	C90.0	C180.0	C270.0
γ 0.0	921.57	921.57	921.57	921.57
γ 1.0	924.36	926.09	909.20	916.40
γ 2.0	921.21	920.81	891.86	899.33
γ 3.0	911.43	907.18	869.62	875.92
γ 4.0	895.48	890.37	845.12	850.67
γ 5.0	875.35	869.83	817.67	821.53
γ 6.0	851.99	846.40	790.48	791.31
γ 7.0	826.05	820.87	760.82	759.18
γ 8.0	798.72	795.23	730.58	727.27
γ 9.0	771.50	765.86	699.71	695.71
γ 10.0	743.39	736.87	669.91	664.96
γ 11.0	715.18	707.68	638.84	634.67
γ 12.0	685.71	678.65	607.25	604.56
γ 13.0	656.95	649.37	577.22	575.31
γ 14.0	626.68	619.72	547.53	547.37
γ 15.0	597.08	591.64	518.46	520.78
γ 16.0	568.02	561.91	490.08	495.48
γ 17.0	539.62	534.07	463.15	471.09
γ 18.0	511.25	507.29	437.47	447.45
γ 19.0	485.74	480.33	412.38	425.02
γ 20.0	460.50	454.01	389.00	404.63
γ 21.0	437.02	428.83	367.85	384.91
γ 22.0	413.83	405.79	348.89	367.12
γ 23.0	392.57	384.18	331.39	350.27
γ 24.0	372.91	364.45	315.61	334.36
γ 25.0	354.99	346.23	301.20	319.96
γ 26.0	337.50	329.21	288.03	306.44
γ 27.0	322.07	312.69	276.05	293.78
γ 28.0	307.19	296.96	264.94	282.21
γ 29.0	294.08	282.86	254.78	272.02
γ 30.0	282.05	269.74	245.34	261.78
γ 31.0	271.08	257.80	236.14	252.32
γ 32.0	260.39	246.81	227.53	242.96
γ 33.0	250.95	236.82	219.31	234.02
γ 34.0	242.12	227.19	210.70	225.43
γ 35.0	233.43	217.21	202.10	217.38
γ 36.0	225.03	207.95	193.79	209.15
γ 37.0	217.03	198.89	185.19	200.93
γ 38.0	208.73	190.36	176.95	192.42
γ 39.0	200.93	181.99	168.12	183.99
γ 40.0	193.06	173.57	159.77	175.32
γ 41.0	184.67	164.97	150.73	166.46
γ 42.0	176.40	156.35	142.13	156.84
γ 43.0	167.82	147.73	133.45	146.81
γ 44.0	159.29	139.17	124.56	136.50
γ 45.0	150.42	130.81	115.40	125.94
γ 46.0	141.30	122.56	105.96	115.10

---

# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

---

## Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 47.0	131.89	113.88	96.28	104.32
γ 48.0	121.66	104.95	86.51	93.67
γ 49.0	111.17	95.73	76.77	83.39
γ 50.0	100.39	86.41	67.39	73.73
γ 51.0	89.75	77.12	58.65	64.64
γ 52.0	79.54	68.09	50.30	56.40
γ 53.0	69.90	59.47	42.62	48.21
γ 54.0	60.77	51.25	35.71	39.88
γ 55.0	52.23	43.03	29.60	31.75
γ 56.0	44.48	34.39	24.52	24.79
γ 57.0	37.49	26.71	20.43	19.48
γ 58.0	31.45	21.08	17.23	15.75
γ 59.0	26.48	17.31	14.74	13.23
γ 60.0	22.40	14.77	12.81	11.41
γ 61.0	19.15	12.91	11.26	9.98
γ 62.0	16.60	11.40	9.97	8.81
γ 63.0	14.62	10.12	8.84	7.82
γ 64.0	13.04	9.00	7.86	7.05
γ 65.0	11.73	8.03	7.03	6.44
γ 66.0	10.64	7.26	6.27	5.95
γ 67.0	9.68	6.58	5.63	5.53
γ 68.0	8.86	6.04	5.07	5.14
γ 69.0	8.13	5.55	4.58	4.80
γ 70.0	7.47	5.12	4.15	4.47
γ 71.0	6.88	4.72	3.78	4.19
γ 72.0	6.34	4.34	3.44	3.91
γ 73.0	5.83	4.01	3.13	3.65
γ 74.0	5.38	3.68	2.82	3.41
γ 75.0	4.95	3.36	2.53	3.16
γ 76.0	4.55	3.06	2.27	2.90
γ 77.0	4.17	2.74	2.04	2.66
γ 78.0	3.80	2.41	1.81	2.43
γ 79.0	3.46	2.14	1.61	2.22
γ 80.0	3.15	1.88	1.39	2.00
γ 81.0	2.86	1.61	1.20	1.76
γ 82.0	2.57	1.35	0.98	1.55
γ 83.0	2.29	1.06	0.80	1.38
γ 84.0	2.00	0.83	0.63	1.22
γ 85.0	1.74	0.63	0.46	1.05
γ 86.0	1.51	0.46	0.27	0.88
γ 87.0	1.29	0.29	0.07	0.70
γ 88.0	1.05	0.09	0.00	0.50
γ 89.0	0.81	0.00	0.00	0.33
γ 90.0	0.56	0.00	0.00	0.23
γ 91.0	0.30	0.00	0.00	0.14
γ 92.0	0.18	0.00	0.00	0.06
γ 93.0	0.10	0.00	0.00	0.00

---



# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

---

## Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 94.0	0.03	0.00	0.00	0.00
γ 95.0	0.00	0.00	0.00	0.00
γ 96.0	0.00	0.00	0.00	0.00
γ 97.0	0.00	0.00	0.00	0.00
γ 98.0	0.00	0.00	0.00	0.00
γ 99.0	0.00	0.00	0.00	0.00
γ 100.0	0.00	0.00	0.00	0.00
γ 101.0	0.00	0.00	0.00	0.00
γ 102.0	0.00	0.00	0.00	0.00
γ 103.0	0.00	0.00	0.00	0.00
γ 104.0	0.00	0.00	0.00	0.00
γ 105.0	0.00	0.00	0.00	0.00
γ 106.0	0.00	0.00	0.00	0.00
γ 107.0	0.00	0.00	0.00	0.00
γ 108.0	0.00	0.00	0.00	0.00
γ 109.0	0.00	0.00	0.00	0.00
γ 110.0	0.00	0.00	0.00	0.00
γ 111.0	0.00	0.00	0.00	0.00
γ 112.0	0.00	0.00	0.00	0.00
γ 113.0	0.00	0.00	0.00	0.00
γ 114.0	0.00	0.00	0.00	0.00
γ 115.0	0.00	0.00	0.00	0.00
γ 116.0	0.00	0.00	0.00	0.00
γ 117.0	0.00	0.00	0.00	0.00
γ 118.0	0.00	0.00	0.00	0.00
γ 119.0	0.00	0.00	0.00	0.00
γ 120.0	0.00	0.00	0.00	0.00
γ 121.0	0.00	0.00	0.00	0.00
γ 122.0	0.00	0.00	0.00	0.00
γ 123.0	0.00	0.00	0.00	0.00
γ 124.0	0.00	0.00	0.00	0.00
γ 125.0	0.00	0.00	0.00	0.00
γ 126.0	0.00	0.00	0.00	0.00
γ 127.0	0.00	0.00	0.00	0.00
γ 128.0	0.00	0.00	0.00	0.00
γ 129.0	0.00	0.00	0.00	0.00
γ 130.0	0.00	0.00	0.00	0.00
γ 131.0	0.00	0.00	0.00	0.00
γ 132.0	0.00	0.00	0.00	0.00
γ 133.0	0.00	0.00	0.00	0.02
γ 134.0	0.00	0.00	0.00	0.08
γ 135.0	0.00	0.00	0.05	0.13
γ 136.0	0.00	0.00	0.12	0.19
γ 137.0	0.00	0.00	0.18	0.26
γ 138.0	0.05	0.00	0.25	0.31
γ 139.0	0.12	0.00	0.32	0.38
γ 140.0	0.17	0.00	0.38	0.44

---

# IES Indoor Report

Photometric Filename:DL44-10-C5-05 3000K RA80 40D.IES

---

## Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 141.0	0.23	0.06	0.45	0.51
γ 142.0	0.30	0.14	0.52	0.57
γ 143.0	0.36	0.20	0.58	0.64
γ 144.0	0.43	0.27	0.66	0.70
γ 145.0	0.49	0.34	0.73	0.77
γ 146.0	0.57	0.40	0.81	0.83
γ 147.0	0.63	0.47	0.87	0.90
γ 148.0	0.70	0.56	0.94	0.96
γ 149.0	0.77	0.63	1.01	1.02
γ 150.0	0.84	0.69	1.08	1.08
γ 151.0	0.91	0.77	1.15	1.15
γ 152.0	0.98	0.84	1.21	1.20
γ 153.0	1.05	0.90	1.26	1.25
γ 154.0	1.11	0.96	1.33	1.31
γ 155.0	1.17	1.03	1.38	1.37
γ 156.0	1.23	1.10	1.44	1.41
γ 157.0	1.29	1.16	1.50	1.46
γ 158.0	1.35	1.21	1.55	1.51
γ 159.0	1.41	1.27	1.59	1.56
γ 160.0	1.47	1.33	1.65	1.60
γ 161.0	1.51	1.37	1.69	1.64
γ 162.0	1.57	1.42	1.73	1.67
γ 163.0	1.62	1.48	1.77	1.72
γ 164.0	1.67	1.53	1.81	1.76
γ 165.0	1.70	1.58	1.84	1.79
γ 166.0	1.75	1.62	1.87	1.81
γ 167.0	1.79	1.66	1.89	1.84
γ 168.0	1.82	1.69	1.92	1.87
γ 169.0	1.87	1.74	1.94	1.89
γ 170.0	1.88	1.77	1.96	1.93
γ 171.0	1.92	1.81	1.98	1.96
γ 172.0	1.95	1.83	2.00	1.97
γ 173.0	1.97	1.85	2.01	2.00
γ 174.0	1.99	1.88	2.03	2.00
γ 175.0	2.01	1.90	2.04	2.03
γ 176.0	2.02	1.93	2.05	2.06
γ 177.0	2.05	1.95	2.05	2.06
γ 178.0	2.06	1.95	2.06	2.07
γ 179.0	2.06	1.97	2.07	2.08
γ 180.0	2.06	2.06	2.06	2.06

---